







## FLOWave SAW flowmeter

- No obstacles inside the measuring tube, compact, lightweight and low energy consumption
- Conforms to hygienic requirements, CIP/SIP compatible
- Ideal for liquids with low or no conductivity
- Digital communication, parameterisation via Communicator, display
- Optional: ATEX/IECEx certification, II 3G/D

Product variants described in the data sheet may differ from the product presentation and description.

### Can be combined with

|   |   |   |
|---|---|---|
|  | <b>Type 8802</b><br>ELEMENT continuous control valve systems - overview                 | ▶ |
|  | <b>Type 8619</b><br>multiCELL - Multi-channel and multi-function transmitter/controller | ▶ |
|  | <b>Type 8647</b><br>AirLINE SP – electro-pneumatic automation system                    | ▶ |
|  | <b>Type ME43</b><br>Fieldbus gateway  | ▶ |

### Type description

The Type 8098 flowmeter is part of the FLOWave product range. It is based on SAW (Surface Acoustic Waves) technology and is mainly designed for applications with the highest hygienic demands. This is achieved by using:

- suitable stainless steel materials
- a measuring tube free of any wetted parts except for the actual tube
- the ideal outer hygienic design.

FLOWave offers a range of integrated functions, including the advantages of flexibility, ease of cleaning, compact dimensions, lightweight, easy installation and handling, and is compliant with numerous standards.

Optimal measurement results can be achieved with homogeneous liquids, free of air and solid particles. For liquids with high viscosity, an integrated viscosity compensation can be activated. Gas and steam cannot be measured; however, their flow does not have any negative effect on the device or its operation and other liquids flowing through afterwards are measured correctly as before.

Beside volume flow, a density measurement optional feature is available. With this option, the mass flow is calculated based on volume flow and density measurements.

Special functions derived from further process values (differentiation factor (DF), acoustic transmission factor, concentration) offer additional information about the particular liquid in use (for details, see chapter “7.2. Special functions” on page 30).

## Table of contents

|  |           |
|--|-----------|
| <b>1. General technical data</b>   | <b>4</b>  |
| 1.1. About the FLOWave flowmeter .....   | 4         |
| 1.2. All variants .....  | 4         |
| 1.3. FLOWave L flowmeter.....  | 9         |
| With or without industrial communication .....                                     | 9         |
| With industrial communication (Ethernet variant) .....                             | 11        |
| 1.4. FLOWave S flowmeter .....   | 13        |
| <b>2. Approvals</b>  | <b>15</b> |
| 2.1. Certification.....  | 15        |
| 2.2. Certificates.....   | 15        |
| 2.3. Pressure equipment directive .....  | 16        |
| Device used on a pipe .....  | 16        |
| <b>3. Materials</b>  | <b>16</b> |
| 3.1. Chemical Resistance Chart – Bürkert resistApp.....                            | 16        |
| 3.2. Material specifications .....   | 17        |
| FLOWave L flowmeter without industrial communication .....                         | 17        |
| FLOWave L flowmeter with industrial communication .....                            | 18        |
| FLOWave S flowmeter .....  | 19        |
| <b>4. Dimensions</b>   | <b>20</b> |
| 4.1. Transmitter of the FLOWave L flowmeter without industrial communication ..... | 20        |
| 4.2. Transmitter of the FLOWave L flowmeter with industrial communication .....    | 20        |
| 4.3. Transmitter of the FLOWave S flowmeter .....                                  | 20        |
| 4.4. Flowmeter with clamp process connection .....                                 | 21        |
| 4.5. Flowmeter with aseptic collar flange (BF).....                                | 23        |
| 4.6. Flowmeter with aseptic collar clamp (BKS) .....                               | 24        |
| 4.7. Flowmeter with thread connection .....  | 25        |
| <b>5. Performance specifications</b>   | <b>25</b> |
| 5.1. Medium temperature.....   | 25        |
| 5.2. Measurement deviation .....   | 26        |
| 5.3. Refresh time.....   | 26        |
| <b>6. Product installation</b>   | <b>27</b> |
| 6.1. Installation notes.....   | 27        |
| 6.2. Selection of the nominal diameter .....                                       | 27        |
| 6.3. Mounting options.....   | 28        |
| FLOWave L flowmeter.....   | 28        |
| FLOWave S flowmeter .....  | 28        |
| <b>7. Product operation</b>  | <b>29</b> |
| 7.1. Measuring principle .....   | 29        |
| 7.2. Special functions .....   | 30        |
| <b>8. Product design and assembly</b>  | <b>31</b> |
| 8.1. Product assembly .....  | 31        |
| <b>9. Product accessories</b>  | <b>32</b> |

## 10. Ordering information

32

|  |    |
|--|----|
| 10.1. Bürkert eShop – Easy ordering and quick delivery.....  | 32 |
| 10.2. Recommendation regarding product selection .....   | 32 |
| 10.3. Bürkert product filter.....  | 33 |
| 10.4. Bürkert 3D Model - Interactive Animation .....   | 33 |
| 10.5. Ordering chart FLOWave L flowmeter with or without industrial communication .....                    | 34 |
| Clamp process connection acc. to DIN 32676 series A for pipe acc. to DIN 11866 series A (DIN 11850) .....  | 34 |
| Clamp process connection acc. to DIN 32676 series B for pipe acc. to DIN 11866 series B (ISO 1127).....    | 35 |
| Clamp process connection acc. to DIN 32676 series C for pipe acc. to DIN 11866 series C (ASME BPE) .....   | 36 |
| Thread process connection acc. to DIN 11851 series A for pipe acc. to DIN 11866 series A (DIN 11850) ..... | 37 |
| 10.6. Ordering chart FLOWave S flowmeter .....   | 38 |
| Clamp process connection acc. to DIN 32676 series A for pipe acc. to DIN 11866 series A (DIN 11850) .....  | 38 |
| Clamp process connection acc. to DIN 32676 series B for pipe acc. to DIN 11866 series B (ISO 1127).....    | 39 |
| Clamp process connection acc. to DIN 32676 series C for pipe acc. to DIN 11866 series C (ASME BPE) .....   | 40 |
| Thread process connection acc. to DIN 11851 series A for pipe acc. to DIN 11866 series A (DIN 11850) ..... | 41 |
| 10.7. Ordering chart accessories.....  | 42 |



## 1. General technical data

### 1.1. About the FLOWave flowmeter

The flowmeter Type 8098 consists of:

- either a flow sensor Type S097 and a transmitter Type SE98 (variant FLOWave L flowmeter), which is available with or without industrial communication (the FLOWave L variant with industrial communication, recognisable by the two M12 female connectors and the M12 male connector, is called the Ethernet variant.)



- or a flow sensor Type S097 and a transmitter Type SE91 (variant FLOWave S flowmeter)



### 1.2. All variants

**Note:**

- The following data applies to all variants.
- In the following table, the term “full scale” refers to full scale of volume flow rate.

#### Product properties

##### Material

Please make sure the device materials are compatible with the fluid you are using.

Detailed information can be found in chapter “[3.1. Chemical Resistance Chart – Bürkert resistApp](#)” on page 16.

Detailed information on the materials can be found in chapter “[3.2. Material specifications](#)” on page 17.

##### Non wetted parts

- |                |   |
|----------------|---|
| Sensor housing | <ul style="list-style-type: none"> <li>• For sensor with process connection <math>\leq</math> DN 50/2": stainless steel 304/1.4301</li> <li>• For sensor with process connection <math>&gt;</math> DN 50/2": stainless steel 316L/1.4435</li> </ul> |
|----------------|---|

##### Wetted parts

- |   |  |
|---|--|
| Measurement tube and process connection | Stainless steel 316L/1.4435 with low delta ferrite content |
|---|--|

##### Surface quality

- |                                  |  |
|----------------------------------|--|
| Measurement tube (inner surface) | <ul style="list-style-type: none"> <li>• <math>R_a &lt; 0.8 \mu\text{m}</math> (30 <math>\mu\text{in.}</math>) or</li> <li>• <math>R_a &lt; 0.4 \mu\text{m}</math> (15 <math>\mu\text{in.}</math>) (electro-polished) according to ISO 4288</li> </ul> |
| Measurement tube (outer surface) | $R_a < 1.6 \mu\text{m}$ (excluding welding seams) according to ISO 4288  |
| Housing                          | $R_a < 1.6 \mu\text{m}$ according to ISO 4288  |
| Dimensions                       | Detailed information can be found in chapter “ <a href="#">4. Dimensions</a> ” on page 20.   |



**Measuring range**

|  |   |
|--|---|
| Volume flow rate measurement             | 0...1.7 m³/h up to 0...200 m³/h<br>Detailed information can be found in chapter <b>"10.5. Ordering chart FLOWave L flowmeter with or without industrial communication"</b> on page 34 or <b>"10.6. Ordering chart FLOWave S flowmeter"</b> on page 38.  |
| Density measurement <sup>1)</sup>        | 0.8...1.3 g/cm³ (inactive by default, selectable upon request)  |
| Mass flow rate measurement <sup>1)</sup> | 0...1 360 kg/h up to 0...260 000 kg/h (inactive by default, selectable upon request)  |
| Temperature measurement                  | -20...+140 °C (-4...+284 °F)  |
| Special function                         | <ul style="list-style-type: none"> <li>• Active by default, deselectable upon request. <ul style="list-style-type: none"> <li>– ATF: acoustic transmission factor</li> <li>– DF: differentiation factor</li> </ul> </li> <li>• Inactive by default, selectable upon request <ul style="list-style-type: none"> <li>– Concentration</li> </ul> </li> </ul> |

Detailed information can be found in chapter **"7.2. Special functions"** on page 30.

**Performance data****Volume flow rate measurement**

Under reference conditions i.e. measuring fluid = water free from gas bubbles and solids, ambient and water temperature = 23 °C ± 1 °C (73.4 °F ± 1.8 F), and short refresh time, while maintaining turbulent or laminar flow profile, with the minimum inlet (40 x DN) and outlet (1 x DN) distances and the appropriate internal diameter of the pipes. Deviation from reference conditions can be adjusted through the use of a built-in correction K factor adjustment or Teach-in Procedure.

|                       |  |
|-----------------------|--|
| Measurement deviation | <ul style="list-style-type: none"> <li>• From 10 % of full scale up to full scale: ± 0.4 % of the measured value</li> <li>• From 1 % of full scale up to 10 % of full scale: ± 0.08 % of full scale</li> </ul> <p>Detailed information can be found in chapter <b>"5.2. Measurement deviation"</b> on page 26.</p> |
| Repeatability         | <ul style="list-style-type: none"> <li>• From 10 % of full scale up to full scale: ± 0.2 % of the measured value</li> <li>• From 1 % of full scale up to 10 % of full scale: ± 0.04 % of full scale</li> </ul>   |
| Refresh time          | Selectable between very short, short and long<br>Detailed information can be found in chapter <b>"5.3. Refresh time"</b> on page 26.   |

**Density measurement**

As an option<sup>1)</sup>

Under reference conditions i.e. measuring fluid = water free from gas bubbles and solids, ambient and water temperature = 23 °C ± 1 °C (73.4 °F ± 1.8 F). Deviations from reference conditions, especially exposure of the device to temperatures above 90 °C can be adjusted through the use of a built in adjustment procedure (see **user manual Type 8098** ▶).

|                       |   |
|-----------------------|---|
| Measurement deviation | <ul style="list-style-type: none"> <li>• Standard product adjustment: ± 2 % of the measured value</li> <li>• After Teach-In: ± 1 % of the measured value (at teach-in density value)</li> </ul> |
| Repeatability         | ± 1 % of the measured value   |
| Refresh time          | Selectable between very short, short and long<br>Detailed information can be found in chapter <b>"5.3. Refresh time"</b> on page 26.  |

**Mass flow rate measurement**

As an option<sup>1)</sup>

Under reference conditions i.e. measuring fluid = water free from gas bubbles and solids, ambient and water temperature = 23 °C ± 1 °C (73.4 °F ± 1.8 F), and short refresh time, while maintaining turbulent or laminar flow profile, with the minimum inlet (40 x DN) and outlet (1 x DN) distances and the appropriate internal diameter of the pipes. Deviation from reference conditions, can be adjusted through the use of a built-in correction K factor adjustment or Teach-in Procedure.

|                       |   |
|-----------------------|---|
| Measurement deviation | <ul style="list-style-type: none"> <li>• Standard K-factor: <ul style="list-style-type: none"> <li>– From 10 % of full scale up to full scale: ± 2.4 % of the measured value</li> <li>– From 1 % of full scale up to 10 % of full scale: ± (2 % of the measured value + 0.08 % of full scale)</li> </ul> </li> <li>• After Teach-In: <ul style="list-style-type: none"> <li>– From 10 % of full scale up to full scale: ± 1.4 % of the measured value at teach-in density and mass flow rate values</li> <li>– From 1 % of full scale up to 10 % of full scale: ± (1 % of the measured value + 0.08 % of full scale) at teach-in density and mass flow rate values</li> </ul> </li> </ul> <p>Detailed information can be found in chapter <b>"5.2. Measurement deviation"</b> on page 26.</p> |
| Repeatability         | <ul style="list-style-type: none"> <li>• From 10 % of full scale up to full scale: ± 1.2 % of the measured value</li> <li>• From 1 % of full scale up to 10 % of full scale: ± (1 % of the measured value + 0.04 % of full scale)</li> </ul>  |
| Refresh time          | Selectable between very short, short and long<br>Detailed information can be found in chapter <b>"5.3. Refresh time"</b> on page 26.  |

**Temperature measurement**

Measurement deviation

- For  $T^\circ \leq 100^\circ\text{C}$  ( $+212^\circ\text{F}$ ):  $\pm 1^\circ\text{C}$  ( $+1.8^\circ\text{F}$ )
- For  $100^\circ\text{C}$  ( $+212^\circ\text{F}$ )  $< T^\circ < 140^\circ\text{C}$  ( $+284^\circ\text{F}$ ):  $\pm 1.5\%$

Refresh time

Approx. 0.1 s

**Electrical data**

Operating voltage

- 12...35 V DC filtered and regulated
- Tolerance:  $\pm 10\%$
- Connection to main supply: permanent (through external SELV (Safety Extra Low Voltage) and LPS (Limited Power Source) power supply)

Power source (not supplied)

Limited power source according to UL/EN 60950-1 standards or limited energy circuit according to UL/EN 61010-1 §9.4

DC reverse polarity protection

Yes

**Voltage supply cable**

For cable gland

- 0.2...1.5 mm<sup>2</sup> cross-section
- In nickel plated brass:
  - Cable with maximum operating temperature greater than  $+80^\circ\text{C}$  ( $+176^\circ\text{F}$ )
  - 5...14 mm diameter, shielded cable
- In stainless steel:
  - Cable with maximum operating temperature greater than  $+80^\circ\text{C}$  ( $+176^\circ\text{F}$ )
  - 6...12 mm diameter, shielded cable

For 5 pin M12 male fixed connector (A-coded)

- Cable with maximum operating temperature greater than  $+80^\circ\text{C}$  ( $+176^\circ\text{F}$ )

For 4 pin M12 female fixed connector (D-coded)

- 3...6.5 mm diameter, shielded cable,
- 0.75 mm<sup>2</sup> cross-section to connect to 5 pin M12 female connector (A-coded, not supplied)
- Cable with maximum operating temperature greater than  $+80^\circ\text{C}$  ( $+176^\circ\text{F}$ )
- 5e / CAT-5 min. category, 100 m max. length, shielded conductor with minimum STP

**Medium data**

Fluid

Non-dangerous liquids complying with article 4, §1 of 2014/68/EU directive. Detailed information can be found in chapter **"2.3. Pressure equipment directive"** on page 16.  
By default the FLOWave flowmeter is set for a fluid with a sound velocity<sup>2)</sup>

- between 1000 m/s and 2000 m/s for process connection DN 08,  $\frac{3}{8}$ " and  $\frac{1}{2}$ "
- between 800 m/s and 2300 m/s for process connection DN  $\geq 15$  or  $\geq \frac{3}{4}$ "

Fluid temperature

- $-20\ldots+110^\circ\text{C}$  ( $-4\ldots+230^\circ\text{F}$ ). The maximum fluid temperature can be restricted by the ambient operating temperature.
- Max. conditions for sterilisation process: up to  $+140^\circ\text{C}$  ( $+284^\circ\text{F}$ ) ( $+130^\circ\text{C}$  ( $+266^\circ\text{F}$ ) for ATEX/IECEx variant) for max. 60 min
- Maximum temperature gradient:  $10^\circ\text{C/s}$  ( $18^\circ\text{F/s}$ ) (measured by the integrated sensor on the device)

**Fluid pressure (max.)**

DN / Pipe standard

DIN 11850

ISO 1127

ASME BPE

SMS 3008

DN 08,  $\frac{3}{8}$ ",  $\frac{1}{2}$ "

PN 25

PN 25

PN 25

–

DN 15,  $\frac{3}{4}$ ", DN 25, 1"

PN 25

PN 25

PN 25

PN 25

DN 40

PN 25

PN 16

–

PN 25

1½", DN 50, 2"

PN 16

PN 16

PN 16

PN 16

DN 65, 2½", DN 80, 3"

PN 10

PN 10

PN 10

–

## Process/Port connection &amp; communication

Process connection size / pipe size<sup>3)</sup> according to

|   |   |
|---|---|
| DIN 32676 series A / DIN 11850          | Clamp: DN 08, DN 15, DN 25, DN 40, DN 50, DN 65 and DN 80                       |
| DIN 32676 series B / ISO 1127           | Clamp: DN 08, DN 15, DN 25, DN 40, DN 50, DN 65 and DN 80                       |
| DIN 32676 series C / ASME BPE           | Clamp: ¾", ½", ¾", 1", 1½", 2", 2½" and 3"                                      |
| DIN 11864-2 form A series A / DIN 11850 | Aseptic collar flange (BF) <sup>4)</sup> : DN 15, DN 25, DN 40 and DN 50        |
| DIN 11864-2 form A series B / ISO 1127  | Aseptic collar flange (BF) <sup>4)</sup> : DN 08, DN 15, DN 25, DN 40 and DN 50 |
| DIN 11864-2 form A series C / ASME BPE  | Aseptic collar flange (BF) <sup>4)</sup> : ½", ¾", 1", 1½" and 2"               |
| DIN 11864-3 form A series A / DIN 11850 | Aseptic collar clamp (BKS) <sup>4)</sup> : DN 15, DN 25, DN 40 and DN 50        |
| DIN 11864-3 form A series B / ISO 1127  | Aseptic collar clamp (BKS) <sup>4)</sup> : DN 08, DN 15, DN 25, DN 40 and DN 50 |
| DIN 11864-3 form A series C / ASME BPE  | Aseptic collar clamp (BKS) <sup>4)</sup> : ½", ¾", 1", 1½" and 2"               |
| SMS 3017 / SMS 3008                     | Clamp: DN 25, DN 40 and DN 50   |
| DIN 11851 series A / DIN 11850          | Thread: DN 65 and DN 80   |
| Device status                           | LED light ring according to NAMUR NE 107  |

## Approvals and Certificates

## Directives

CE directive The applied standards, which verify conformity with the EU Directives, can be found on the EU Type Examination Certificate and/or the EU Declaration of conformity (if applicable).

Pressure equipment directive Complying with Article 4, Paragraph 1 of 2014/68/EU directive  
Detailed information on the pressure equipment directive can be found in chapter "2.3. Pressure equipment directive" on page 16.

Certification

- EHEDG (Type EL CLASS I)<sup>5)</sup>
- 3A (28-06)<sup>6)</sup>
- On request:
  - UL-Listed for USA and Canada
  - ATEX/IECEx<sup>7)</sup>

Certificate

- FDA declaration of conformity
- Inspection certificate 3.1
- Certification of compliance ASME BPE
- Calibration certificate
- On request:
  - USP class VI declaration
  - ECR1935/2004 declaration
  - CRN 0C21751 declaration<sup>8)</sup>
  - Test report 2.2
  - Certification of conformity for the surface quality DIN 4762, EN ISO 4287, EN ISO 4288
  - Certification of conformity for passivation and electro-polishing processes
  - MTBF (Mean Time Between Failures) manufacturer declaration

## Environment and installation

## Ambient temperature

|                        |   |
|------------------------|---|
| Operation              | Depends on the fluid temperature. Detailed information can be found in chapter "5.1. Medium temperature" on page 25.  |
| Storage                | -20...+70 °C (-4...+158 °F)   |
| Relative air humidity  | ≤ 85 %, without condensation  |
| Height above sea level | Max. 2000 m   |
| Operating condition    | Continuous  |
| Equipment mobility     | Fixed device  |
| Application range      | Indoor and outdoor (protect the device against electromagnetic interference, ultraviolet rays and, when installed outdoors, against the effects of climatic conditions) |

|                                     |   |
|-------------------------------------|---|
| Degree of protection <sup>9.)</sup> | IP65, IP67 (according to IEC/EN 60529), NEMA 4X (according to NEMA250), if the product is wired and if the cable glands are tightened and the covers are screwed tight. Unused cable glands must be sealed with the stopper gaskets provided (mounted upon delivery of the product). An unused M12 fixed connector must be protected by the screwed plug. |
| Installation category               | Category I according to UL/EN 61010-1   |
| Pollution degree                    | Degree 2 according to UL/EN 61010-1   |

1.) Only for a flowmeter FLOWave with a process connection size of DN 08...DN 50 or ½"...2", pending for the other dimensions

2.) Customer specific setting on request. Please contact your Bürkert partners!

3.) Please refer to the dimension table of the sensor, see chapters "4.4. Flowmeter with clamp process connection" on page 21, "4.5. Flowmeter with aseptic collar flange (BF)" on page 23, "4.6. Flowmeter with aseptic collar clamp (BKS)" on page 24, and "4.7. Flowmeter with thread connection" on page 25.

4.) In German: BF = Bundflansch, BKS= Bundklemmstutzen

5.) The EHEDG compliance for :

- clamp connection according to DIN 32676 is only valid if used in combination with EHEDG-compliant gaskets from Combifit International B.V.
- threaded connection according to DIN 11851 is only valid if used in combination with EHEDG-compliant gaskets from
  1. Kieselmann GmbH, Germany (ASEPTO-STAR k-flex upgrade gaskets) or
  2. Siersema Komponenten Service (S.K.S.) B.V. (Netherlands SKS gasket set DIN 11851 EHEDG with EPDM or FKM inner gasket)

6.) Except for a FLOWave flowmeter with a process connection

- SMS3017 (SMS3008) in DN 65, DN80 or
- DIN11864-2 series C (ASME BPE) in sizes 2 ½"; 3"

7.) Only for a flowmeter FLOWave L with a process connection size of DN 08...DN 50 or ¾"...2", pending for the other dimensions

8.) Only for a flowmeter with a process connection size of ¾"...2", pending for the other dimensions

9.) Not evaluated by UL, only IP64 is evaluated by the ATEX/IECEx notified/certification body.



### 1.3. FLOWave L flowmeter

The FLOWave L flowmeter is available in four variants of the transmitter:

- Stainless steel transmitter with nickel plated brass cable glands and M12 male connector
- Stainless steel transmitter with stainless steel cable glands and M12 male connector (full stainless steel variant)
- Stainless steel transmitter with stainless steel M12 female and male connectors and industrial communication (Ethernet variant)
- Stainless steel transmitter with stainless steel cable glands and M12 male connector (ATEX/IECEX variant).



#### With or without industrial communication

The following data applies to all variants (unless specified differently).

#### Product properties

##### Material

Detailed information on the materials can be found in chapter **"3.2. Material specifications"** on page 17.

##### Non wetted parts

|                                      |   |
|--------------------------------------|---|
| Blind cover                          | Stainless steel 304/1.4301  |
| Transmitter housing                  | Stainless steel 304/1.4301  |
| Functional earth element             | Cylinder screw, washer, washer spring in stainless steel A4 and blind rivet nut in stainless steel 1.4578/A4  |
| Pressure compensating element        | Diaphragm in ePTFE (expanded polytetrafluoroethylene), O-ring in silicone 60 Shore A, body in stainless steel   |
| Display module                       | Float glass, stainless steel 304/1.4301 and EPDM (ethylene propylene diene monomer) seal  |
| Seal                                 | VMQ silicone (Methyl Vinyl Silicone)  |
| M12 fixed connector and screwed plug | <ul style="list-style-type: none"> <li>• 4 pin M12 female: <ul style="list-style-type: none"> <li>– Body in stainless steel 304L/1.4307, contact support in PBT GF30 (Polybutyleneterephthalate 30 % glass fibre reinforced) and seal in EPDM</li> </ul> </li> <li>• 5 pin M12 male: <ul style="list-style-type: none"> <li>– Body in nickel plated brass and seal in NBR (nitrile butadiene rubber) or</li> <li>– Body in stainless steel 316L/1.4404 and seal in NBR or VMQ silicone</li> </ul> </li> </ul> |
| Cable gland                          | <ul style="list-style-type: none"> <li>• Body in nickel plated brass and seal in TPE (thermoplastic elastomer) or</li> <li>• Body in stainless steel 304L/1.4307 and seal in TPE (FDA-compliant) or</li> <li>• Body in stainless steel 316L/1.4404 and seal in EPDM</li> </ul>  |
| Blind plug                           | Black POM (polyoxymethylene), PA6 or PA   |
| Display                              | <ul style="list-style-type: none"> <li>• 2.4", monochrome graphic (240 × 160 pixels)</li> <li>• Languages: German, English, French</li> </ul>   |

| Weight (approx. in kg) | DN 08,<br>3/8", 1/2" | DN 15,<br>3/4" | DN 25,<br>1" | DN 40,<br>1 1/2" | DN 50,<br>2" | DN 65,<br>2 1/2" | DN 80,<br>3" |
|------------------------|----------------------|----------------|--------------|------------------|--------------|------------------|--------------|
| Clamp                  | 2.1                  | 2              | 2.2          | 3                | 3.2          | 5.4              | 5.5          |
| Flange                 | 2.3                  | 2.4            | 2.7          | 3.6              | 3.8          | –                | –            |
| Thread (dairy thread)  | –                    | –              | –            | –                | –            | 5.7              | 6.1          |

#### Performance data

|                              |                                 |
|------------------------------|---------------------------------|
| Frequency resolution         | 0.05 Hz over 0...2 000 Hz range |
| 4...20 mA output uncertainty | ±0.04 mA                        |
| 4...20 mA output resolution  | 0.8 µA                          |

**Electrical data**

## Power consumption

Without any consumption of output

- For device with 2 x M20 x 1.5 cable glands and 1 x 5 pin M12 connector: max. 5 W
- For device with 2 x 4 pin M12 connectors and 1 x 5 pin M12 connector, Ethernet variant: max. 8 W
- For device with 2 x 4 pin M12 connectors and 1 x 5 pin M12 connector, Ethernet variant, with display module: max. 9 W

**Output**

## Number of outputs

**Valid for non-Ethernet variants only**

3 (1 digital, 1 analogue and 1 configurable: digital or analogue)

## Digital output

Overload information (through software diagnostics function)

Transistor:

- Type: NPN or PNP (wiring dependent), open collector, galvanically isolated
- Operating modes: pulse (by default), On/Off, threshold, frequency (user configurable)
- 0...2 kHz, 5...35 V DC, max. 700 mA, max. pulse duration: 2 s, selectable limits:
  - 0.0001...10 000 pulses/litre or 0.0001...9 999.99 litres/pulse
  - 0.0001...10 000 pulses/kg or 0.0001...9 999.99 kg/pulse<sup>1.)</sup>

## Analogue output

Open loop detection (through software diagnostics function)

Current:

- 4...20 mA
- 3.6 mA or 22 mA to indicate an error (only if 4...20 mA scale selected); galvanically isolated
- Max. loop impedance: 1 300 Ω at 35 V DC, 1 000 Ω at 30 V DC, 700 Ω at 24 V DC, 450 Ω at 18 V DC

**Process/Port connection & communication**

## Electrical connection

2 x M20 x 1.5 cable glands and 1 x 5 pin M12 male fixed connector (A-coded) for non-Ethernet variants only

## Data transfer

External communication through bus (Bürkert system bus, CANopen protocol)

**Environment and installation****Ambient temperature**

## Operation

- For device with 2 x M20 x 1.5 cable glands and 1 x 5 pin M12 connector:
  - -10...+70 °C (+14...+158 °F) or -10...+40 °C (+14...+104 °F) for ATEX/IECEx variant, if -20 °C (4 °F) ≤ fluid temperature ≤ 80 °C (176 °F),
  - At a fluid temperature > 80 °C (176 °F), the maximum ambient temperature decreases linearly from 70 °C (158 °F) up to 40 °C (104 °F) or from 40 °C (104 °F) up to 30 °C (86 °F) for ATEX/IECEx variant.

This means that at a fluid temperature of 80 °C (176 °F) the ambient temperature may be a maximum of 70 °C and at a fluid temperature of 140 °C (300 °F for the ATEX/IECEx variant) the ambient temperature may only be a maximum of 40 °C (30 °C for the ATEX/IECEx variant).
- For device with 2 x 4 pin M12 female connectors and 1 x 5 pin M12 connector, Ethernet variant: -10...+55 °C (+14...+131 °F)

Detailed information can be found in chapter **“5.1. Medium temperature”** on page 25.

1.) Only if option density and mass flow is activated

## With industrial communication (Ethernet variant)

## Process/Port connection &amp; communication

|                       |  |
|-----------------------|--|
| Electrical connection | 2 × 4 pin M12 female fixed connectors (D-coded) and 1 × 5 pin M12 male fixed connector (A-coded) |
|-----------------------|--|

## Industrial Communication

|                            |   |
|----------------------------|---|
| Supported network protocol | <ul style="list-style-type: none"> <li>• Modbus TCP</li> <li>• PROFINET</li> <li>• EtherNet/IP</li> <li>• EtherCAT</li> </ul> |
| Light-emitting diode       | <ul style="list-style-type: none"> <li>• 2 Link/Act LEDs (green)</li> <li>• 2 Link LEDs (yellow)</li> </ul>                   |

## Modbus TCP protocol

|                    |   |
|--------------------|---|
| Protocol           | Internet protocol, version 4 (IPv4)   |
| Network topology   | <ul style="list-style-type: none"> <li>• Tree</li> <li>• Star</li> <li>• Line (open daisy chain)</li> </ul>   |
| IP configuration   | <ul style="list-style-type: none"> <li>• Static IP address</li> <li>• Not supported: BOOTP (Bootstrap Protocol), DHCP (Dynamic Host Configuration)</li> </ul> |
| Transmission speed | 10 or 100 MBit/s  |

## PROFINET protocol

|                                      |   |
|--------------------------------------|---|
| PROFINET IO specification            | V2.3  |
| Network topology                     | <ul style="list-style-type: none"> <li>• Tree</li> <li>• Star</li> <li>• Ring (closed daisy chain)</li> <li>• Line (open daisy chain)</li> </ul>  |
| Network management                   | <ul style="list-style-type: none"> <li>• LLDP (Link Layer Discovery Protocol)</li> <li>• SNMP V1 (Simple Network Management Protocol)</li> <li>• MIB (Management Information Base)</li> </ul> |
| IP configuration                     | <ul style="list-style-type: none"> <li>• DCP (Discovery and Configuration Protocol)</li> <li>• Manual (Device naming and IP setting)</li> </ul>   |
| Transmission speed                   | 100 MBit/s full duplex  |
| Maximum supported conformance class  | CC-B  |
| Media Redundancy (for ring topology) | MRP client is supported   |
| GSDml file                           | See <b>Device Description Files Type 8098</b> ► on the website in the Software chapter.   |

## EtherNet/IP protocol

|                                       |   |
|---------------------------------------|---|
| Protocol                              | Internet protocol, version 4 (IPv4)   |
| Network topology                      | <ul style="list-style-type: none"> <li>• Tree</li> <li>• Star</li> <li>• Ring (closed daisy chain)</li> <li>• Line (open daisy chain)</li> <li>• Linear (open Daisy Chain)</li> </ul> |
| IP configuration                      | <ul style="list-style-type: none"> <li>• Static IP address</li> <li>• BOOTP (Bootstrap Protocol)</li> <li>• DHCP (Dynamic Host Configuration Protocol)</li> </ul>                     |
| Transmission speed                    | 10 or 100 MBit/s  |
| Duplex mode                           | Half duplex, full duplex, auto-negotiation  |
| MDI mode (Medium Dependant Interface) | Auto-MDIX   |
| Predefined standard objects           | Identity, Message Router, Assembly, Connection Manager, DLR, QoS, TCP/IP Interface, Ether-Net Link object   |
| EDS file                              | See <b>Device Description Files Type 8098</b> ► on the website in the Software chapter.   |

**EtherCAT protocol<sup>1.)</sup>**

Industrial Ethernet interface X1, X2 X1: EtherCAT IN, X2: EtherCAT OUT

Maximum number of cyclic input/  
output data 512 bytes in totalMaximum number of cyclic input  
data 1024 bytesMaximum number of cyclic output  
data 1024 bytesAcyclic communication (CoE)

- SDO
- SDO master-slave
- SDO slave-slave (depends on master capacity)

Type Complex slave

Fieldbus Memory Management  
Unit (FMMU) 8

Sync Manager 4

Transmission speed 100 Mbit/s

**Approvals and Certificates**Certification

- PROFINET
- EtherNet/IP

1.) EtherCAT® is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH.





### 1.4. FLOWave S flowmeter

The FLOWave S flowmeter is available in four variants of the transmitter:

- Stainless steel transmitter without output and with stainless steel 5 pin M12 connector
- Stainless steel transmitter with 2 configurable outputs (DO/AO) and stainless steel 8 pin M12 connector
- Stainless steel transmitter without output and with stainless steel 5 pin M12 connector (ATEX/IECEx variant)
- Stainless steel transmitter with 2 configurable outputs (DO/AO) and stainless steel 8 pin M12 connector (ATEX/IECEx variant)



#### Product properties

##### Material

Detailed information on the materials can be found in chapter "3.2. Material specifications" on page 17.

##### Non wetted parts

|                                      |   |
|--------------------------------------|---|
| Cover                                | Stainless steel 304/1.4301  |
| Light guide                          | PC (Polycarbonate) and O-ring in EPDM (Ethylene Propylene Diene Monomer)              |
| Transmitter housing                  | Stainless steel 304/1.4301  |
| Seal                                 | Between sensor and transmitter: VMQ silicone (Methyl Vinyl Silicone)                  |
| M12 fixed connector and screwed plug | 5- or 8-pin M12 male: stainless steel 316L/1.4404 or 303/1.4305 and with seal in EPDM |

| Weight (approx. in kg) | DN 08,<br>⅜", ½" | DN 15,<br>¾" | DN 25,<br>1" | DN 40,<br>1½" | DN 50,<br>2" | DN 65,<br>2½" | DN 80,<br>3" |
|------------------------|------------------|--------------|--------------|---------------|--------------|---------------|--------------|
| Clamp                  | 1.7              | 1.6          | 1.8          | 2.6           | 2.8          | 5.0           | 5.1          |
| Flange                 | 1.9              | 2.0          | 2.3          | 3.2           | 3.4          | –             | –            |
| Thread (dairy thread)  | –                | –            | –            | –             | –            | 5.3           | 5.7          |

#### Electrical data

|                   |  |
|-------------------|--|
| Power consumption | <ul style="list-style-type: none"> <li>• For device without output: max. 2.5 W</li> <li>• For device with 2 outputs (DO/AO): max. 5 W</li> </ul> |
|-------------------|--|

##### Output

|                   |  |
|-------------------|--|
| Number of outputs | 2, each configurable as digital or analogue output   |
| Digital output    | Overload information (through software diagnostics function)<br>Transistor: <ul style="list-style-type: none"> <li>• Type: NPN or PNP (wiring dependent), open collector, galvanically isolated</li> <li>• Operating modes: pulse (by default), On/Off, threshold, frequency (user configurable)</li> <li>• 0...2 kHz, 5...35 V DC, max. 700 mA, max. pulse duration: 2 s, selectable limits:               <ul style="list-style-type: none"> <li>– 0.0001...10 000 pulses/litre or 0.0001...9 999.99 litres/pulse</li> <li>– 0.0001...10 000 pulses/kg or 0.0001...9 999.99 kg/pulse<sup>1,3)</sup></li> </ul> </li> <li>• Protected against polarity reversals of DC and overloads</li> </ul> |
| Analogue output   | Open loop detection (through software diagnostics function)<br>Current: <ul style="list-style-type: none"> <li>• 4...20 mA</li> <li>• 3.6 mA or 22 mA to indicate an error (only if 4...20 mA scale selected); galvanically isolated</li> <li>• Max. loop impedance: 1300 Ω at 35 V DC, 1000 Ω at 30 V DC, 700 Ω at 24 V DC, 450 Ω at 18 V DC</li> </ul>   |

#### Process/Port connection & communication

|                       |  |
|-----------------------|--|
| Electrical connection | <ul style="list-style-type: none"> <li>• 1 × 5 pin M12 male fixed connector (A-coded) for device without output</li> <li>• 1 × 8 pin M12 male fixed connector (A-coded) for device with 2 outputs</li> </ul> |
|-----------------------|--|

## Data transfer

- Device without output: external communication through bÜS (Bürkert system bus, CANopen protocol)
- Device with 2 outputs: bÜS connection only to the Bürkert Communicator for configuration and software update of the device. Due to the missing CAN shield the conventional bÜS/CANopen communication is not recommended.

## Environment and installation

## Ambient temperature

## Operation

- $-10...+70\text{ °C}$  ( $+14...+158\text{ °F}$ ) if  $-20\text{ °C}$  ( $4\text{ °F}$ )  $\leq$  fluid temperature  $\leq 80\text{ °C}$  ( $176\text{ °F}$ ) or for ATEX/IECEX variant,  $-10...+60\text{ °C}$  ( $+14...+140\text{ °F}$ ) if  $-20\text{ °C}$  ( $4\text{ °F}$ )  $\leq$  fluid temperature  $\leq 100\text{ °C}$  ( $212\text{ °F}$ )
- At a fluid temperature  $>80\text{ °C}$  ( $176\text{ °F}$ ), the maximum ambient temperature decreases linearly from  $70\text{ °C}$  ( $158\text{ °F}$ ) up to  $40\text{ °C}$  ( $104\text{ °F}$ ).  
This means that at a fluid temperature of  $80\text{ °C}$  ( $176\text{ °F}$ ) the ambient temperature may be a maximum of  $70\text{ °C}$  ( $158\text{ °F}$ ) and at a fluid temperature of  $140\text{ °C}$  ( $284\text{ °F}$ ) the ambient temperature may only be a maximum of  $40\text{ °C}$  ( $104\text{ °F}$ ).  
or for ATEX/IECEX variant, at a fluid temperature  $>100\text{ °C}$  ( $212\text{ °F}$ ), the maximum ambient temperature decreases linearly from  $60\text{ °C}$  ( $140\text{ °F}$ ) up to  $45\text{ °C}$  ( $136\text{ °F}$ ).  
This means that at a fluid temperature of  $100\text{ °C}$  ( $212\text{ °F}$ ) the ambient temperature may be a maximum of  $60\text{ °C}$  ( $140\text{ °F}$ ) and at a fluid temperature of  $130\text{ °C}$  ( $266\text{ °F}$ ) the ambient temperature may only be a maximum of  $45\text{ °C}$  ( $136\text{ °F}$ )

Detailed information can be found in chapter "5.1. Medium temperature" on page 25.







1.) Only if option density measurement and mass flow rate measurement is activated

## 2. Approvals


### Note:

- The certification/certificate listed below must be stated when making enquiries. This is the only way to ensure that the product complies with all required specifications.
- Not all available devices can be supplied with the certification/certificate below.

### 2.1. Certification

| Certificate  | Description  |                     |                     |  |  |
|--|--|---------------------|---------------------|--|--|
|   | <b>EHEDG (Type EL - CLASS I)</b><br>The EHEDG compliance is only valid <ul style="list-style-type: none"> <li>if the flowmeter with clamp connection according to DIN 32676 is used in combination with gaskets from Combifit International B.V.</li> <li>if the flowmeter with threaded connection according to DIN 11851 is used in combination with gaskets from               <ul style="list-style-type: none"> <li>Kieselmann GmbH, Germany (ASEPTO-STAR k-flex upgrade gaskets) or</li> <li>Siersema Komponenten Service (S.K.S.) B.V. (Netherlands SKS gasket set DIN 11851 EHEDG with EPDM or FKM inner gasket)</li> </ul> </li> </ul>  |                     |                     |  |  |
|   | <b>3-A Sanitary Standards</b><br>The Type 8098 meets sanitary standards for design and fabrication.<br>Certificate authorization number: 1178  |                     |                     |  |  |
|  Measuring Equipment E237737  | <b>UL-Listed for USA and Canada</b><br>Products are UL-listed products and comply also with the following standards: <ul style="list-style-type: none"> <li>UL 61010-1</li> <li>CAN/CSA-C22.2 No.61010-1</li> </ul> Certificate number: 2017-10-27-E237737   |                     |                     |  |  |
|   | <b>Explosion proof</b><br>As Category 3 device suitable for zone 2/22 (optional) <table border="1"> <thead> <tr> <th>FLOWave L flowmeter</th><th>FLOWave S flowmeter</th></tr> </thead> <tbody> <tr> <td> <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> </td><td> <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T130 °C Dc</li> </ul> </td></tr> </tbody> </table> Measures to comply with ATEX/IECEx requirements: refer to the <ul style="list-style-type: none"> <li><b>Supplement Type 8098 FLOWave L   ATEX/IECEx Variant ▶</b> or</li> <li><b>Supplement Type 8098 FLOWave S   ATEX/IECEx Variant ▶</b></li> </ul> under user manual.<br>The Ex. certification is only valid if the Bürkert device is used as described in the supplement ATEX/IECEx. If unauthorized changes are made to the device, the Ex. certification becomes invalid. | FLOWave L flowmeter | FLOWave S flowmeter | <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> | <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T130 °C Dc</li> </ul> |
| FLOWave L flowmeter  | FLOWave S flowmeter  |                     |                     |  |  |
| <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T110 °C Dc or T130 °C Dc</li> </ul> | <b>ATEX</b> <ul style="list-style-type: none"> <li>II 3G Ex ec IIC T4 Gc</li> <li>II 3D Ex tc IIIC T130 °C Dc</li> </ul> <b>IECEx</b> <ul style="list-style-type: none"> <li>Ex ec IIC T4 Gc</li> <li>Ex tc IIIC T130 °C Dc</li> </ul>   |                     |                     |  |  |
|   | <b>PROFINET</b><br>Certificate number: Z12446  |                     |                     |  |  |
|   | <b>EtherNet/IP</b><br>Document number: 11839   |                     |                     |  |  |

### 2.2. Certificates

| Certificate  | Description  |
|--|--|
| FDA  | The devices comply in their composition with the Code of Federal Regulations published by the FDA (Food and Drug Administration, USA). |
| EtherCAT  | EtherCAT® is a registered trademark and patented technology, licensed by Beckhoff Automation GmbH                                      |

### 2.3. Pressure equipment directive

The device conforms to article 4, paragraph 1 of the pressure equipment directive 2014/68/EU under the following conditions:

#### Device used on a pipe

##### Note:

- The data in the table is independent of the chemical compatibility of the material and the fluid.
- PS = maximum admissible pressure, DN = nominal diameter of the pipe

| Type of fluid                              | Conditions   |
|--|--|
| Fluid group 1, article 4, paragraph 1.c.i  | $DN \leq 25$   |
| Fluid group 2, article 4, paragraph 1.c.i  | $DN \leq 32$ or $PS \cdot DN \leq 1000$                  |
| Fluid group 1, article 4, paragraph 1.c.ii | $DN \leq 25$ or $PS \cdot DN \leq 2000$                  |
| Fluid group 2, article 4, paragraph 1.c.ii | $DN \leq 200$ or $PS \leq 10$ or $PS \cdot DN \leq 5000$ |

## 3. Materials

### 3.1. Chemical Resistance Chart – Bürkert resistApp



#### Bürkert resistApp – Chemical Resistance Chart

You want to ensure the reliability and durability of the materials in your individual application case? Verify your combination of media and materials on our website or in our resistApp.

[Start Chemical Resistance Check](#)




### 3.2. Material specifications

#### FLOWave L flowmeter without industrial communication

**Note:**


The following picture describes a device with 2 x M20 x 1.5 cable glands, 1 x 5 pin M12 male connector and clamp process connection.

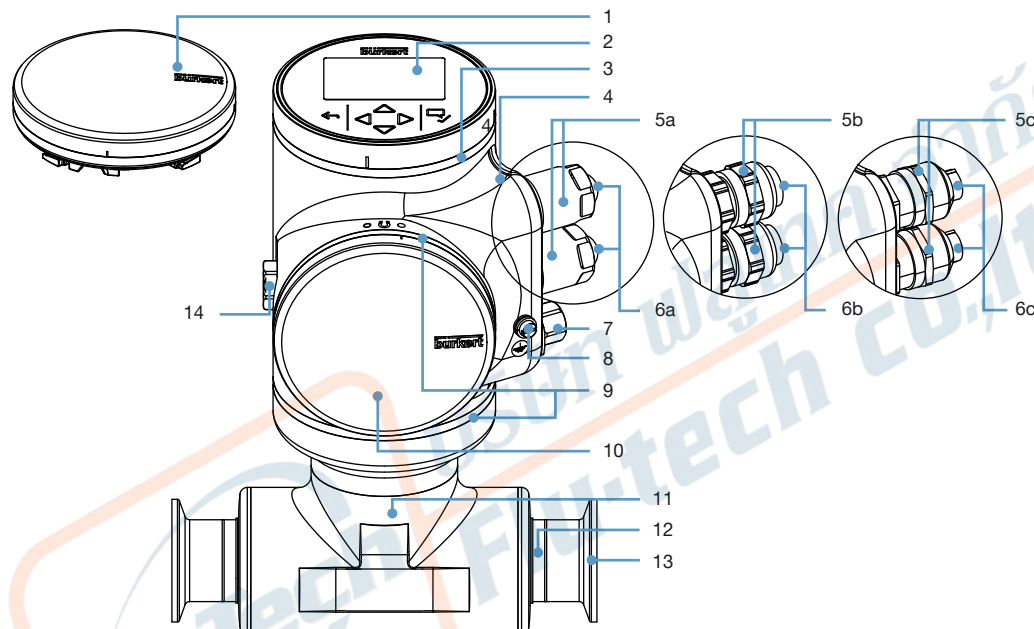

| No. | Description  | Material   |
|-----|--|--|
| 1   | Blind cover  | Stainless steel 304/1.4301   |
| 2   | Display module   | Float glass, stainless steel 304/1.4301  |
| 3   | Multi-colour LED behind seal (used for e.g. to indicate the status of the product, based on the NAMUR NE 107 standard) | VMQ silicone   |
| 4   | Transmitter housing  | Stainless steel 304/1.4301   |
| 5   | Cable gland (full stainless steel variant)   | Body in stainless steel 304L/1.4307 and seal in TPE (according to FDA)   |
| 6a  | Cable glands   | Body in nickel plated brass and seal in TPE  |
| 6b  | Cable glands (ATEX/IECEx variant)  | Body in stainless steel 316L/1.4404 and seal in EPDM   |
| 6c  | Blind plug (full stainless steel variant)  | PA6  |
| 7a  | Blind plug   | Black POM  |
| 7b  | Blind plug (ATEX/IECEx variant)  | PA   |
| 7c  | 5 pin M12 male fixed connector (wired to bÜS) with screwed plug  | <ul style="list-style-type: none"> <li>Body in stainless steel 316L/1.4404 and seal in NBR (if equipped with 6a) or in VMQ silicone (if equipped with 6c) or</li> <li>Body in nickel plated brass and seal in NBR (if equipped with 6b)</li> </ul> |
| 8   | Functional earth   | Cylinder screw, washer, washer spring in stainless steel A4 and blind rivet nut in stainless steel 1.4578/A4   |
| 9   | Seal   | VMQ silicone   |
| 10  | Blind cover  | Stainless steel 304/1.4301   |
| 11  | Sensor housing   | For sensor with process connection: <ul style="list-style-type: none"> <li>≤ DN 50/2": stainless steel 304/1.4301</li> <li>&gt; DN 50/2": stainless steel 316L/1.4435</li> </ul>   |
| 12  | Sensor measurement tube  | Stainless steel 316L/1.4435 with low delta ferrite content   |
| 13  | Process connection (either clamp connections or flange connections)  | Stainless steel 316L/1.4435 with low delta ferrite content   |
| 14  | Pressure compensating element  | Diaphragm in ePTFE, O-ring in silicone 60 Shore A and body in stainless steel (316L/1.4404)  |

**FLOWave L flowmeter with industrial communication****Note:**

The following picture describes a device (Ethernet variant) with 2 × 4 pin M12 female connectors, 1 × 5 pin M12 male connector and flange process connection.

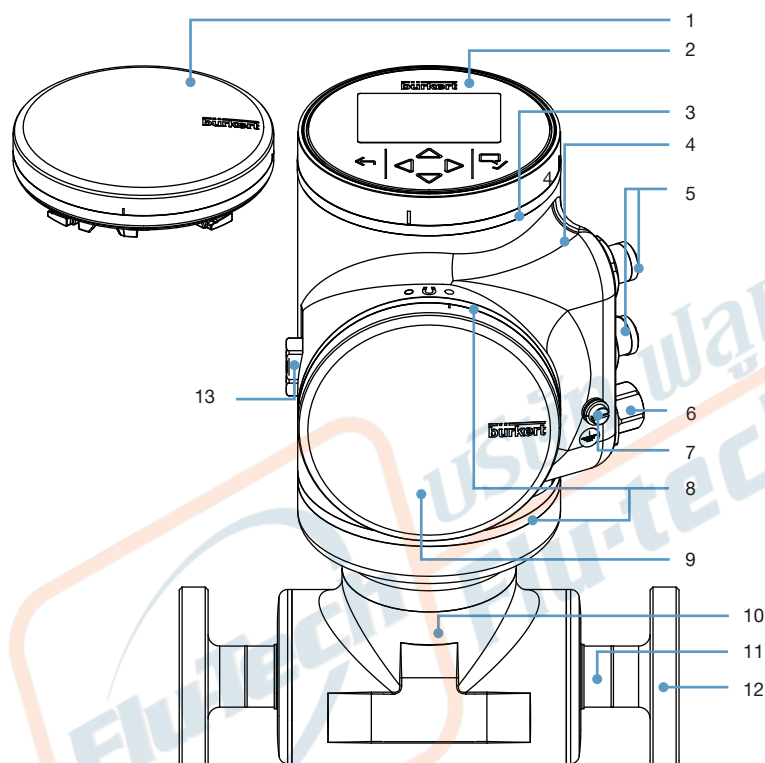


| No. | Description  | Material  |
|-----|--|---|
| 1   | Blind cover or   | Stainless steel 304/1.4301  |
| 2   | Display module   | Float glass, stainless steel 304/1.4301   |
| 3   | Multi-colour LED behind seal (used for e.g. to indicate the status of the product, based on the NAMUR NE 107 standard) | VMQ silicone  |
| 4   | Transmitter housing  | Stainless steel 304/1.4301  |
| 5   | 4 pin M12 female fixed connectors with screwed plug  | Body in stainless steel 304L/1.4307, contact support in PBT GF30 and seal in EPDM                       |
| 6   | 5 pin M12 male fixed connector (wired to bUS) with screwed plug  | Body in stainless steel 316L/1.4404 and seal in NBR   |
| 7   | Functional earth   | Cylinder screw, washer, washer spring: stainless steel A4<br>blind rivet nut: stainless steel 1.4578/A4 |
| 8   | Blind cover  | VMQ silicone  |
| 9   | Seal   | Stainless steel 304/1.4301  |
| 10  | Sensor housing   | Stainless steel 304/1.4301 <sup>1.)</sup>   |
| 11  | Sensor measurement tube  | Stainless steel 316L/1.4435 with low delta ferrite content  |
| 12  | Process connection (either clamp connections or flange connections)  | Stainless steel 316L/1.4435 with low delta ferrite content  |
| 13  | Pressure compensating element  | Diaphragm: ePTFE; support: polyester; O-ring: silicone 60 Shore A; body: stainless steel (316L/1.4404)  |

1.) If instead of flange connections there are clamp connections according to DIN 32676 or threaded connections according to DIN 11851, the material of the sensor housing for DN > 50 is stainless steel 316L/1.4435.

## FLOWave S flowmeter

## Note:

The following picture shows a device with 1 × 5 pin M12 male connector and clamp process connection.

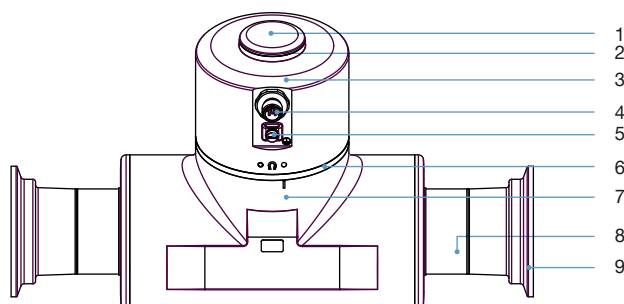

| No. | Description  | Material   |
|-----|--|--|
| 1   | Cover  | Stainless steel 304/1.4301   |
| 2   | Light guide for status display behind seal (used for e.g. indicating the status of the product, based on the NAMUR NE 107 standard)  | PC and O-ring in EPDM  |
| 3   | Transmitter housing  | Stainless steel 304/1.4301   |
| 4   | 5 pin M12 male fixed connector (wired to bUS) with screwed plug or 8 pin M12 male fixed connector (wired to bUS as service interface <sup>1.)</sup> and 2 x DO/AO) (with screwed plug) | Stainless steel 316L/1.4404 or 303/1.4305 and seal in EPDM   |
| 5   | Functional earth   | Cylinder screw, washer, washer spring: stainless steel A4<br>blind rivet nut: stainless steel 1.4578/A4                      |
| 6   | Seal   | VMQ silicone   |
| 7   | Sensor housing   | For sensor with process connection:<br>• ≤ DN 50/2": stainless steel 304/1.4301<br>• > DN 50/2": stainless steel 316L/1.4435 |
| 8   | Sensor measurement tube  | Stainless steel 316L/1.4435 with low delta ferrite content   |
| 9   | Process connection (either clamp connections or flange connections)  | Stainless steel 316L/1.4435 with low delta ferrite content   |


1.) bUS connection only to the Bürkert communicator for configuration and software update of the device. Due to the missing CAN shield the conventional bUS/ CANopen communication is not recommended.

## 4. Dimensions

### 4.1. Transmitter of the FLOWave L flowmeter without industrial communication

**Note:**


Specifications in mm

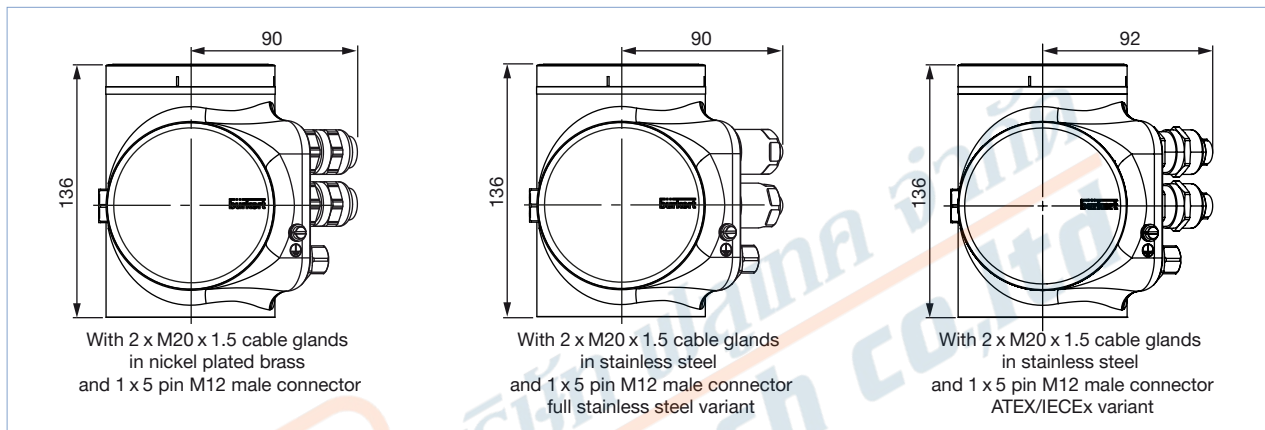

### 4.2. Transmitter of the FLOWave L flowmeter with industrial communication

**Note:**


Specifications in mm

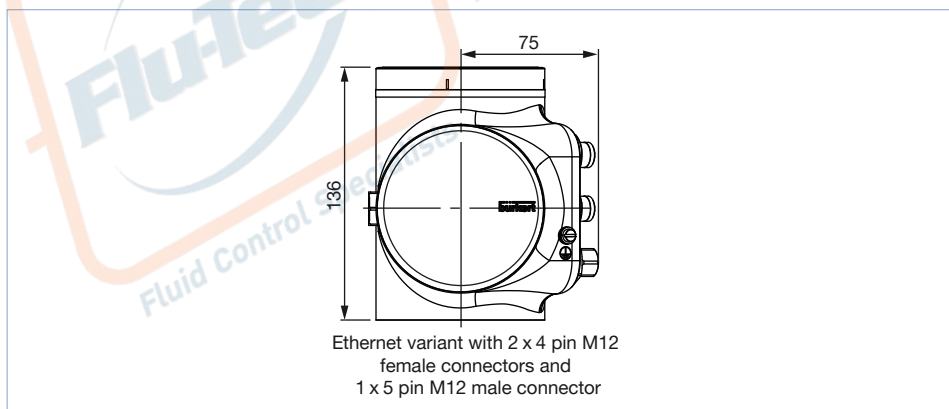

### 4.3. Transmitter of the FLOWave S flowmeter

**Note:**

Specifications in mm

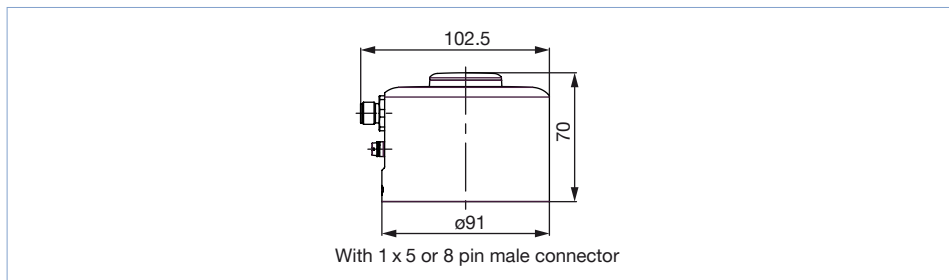




#### 4.4. Flowmeter with clamp process connection


##### Note:

- Specifications in mm (unless specified differently)
- Clamp according to DIN 32676 series A, B or C, or SMS 3017

Sensor with process connection  $\leq$  DN 50/2"

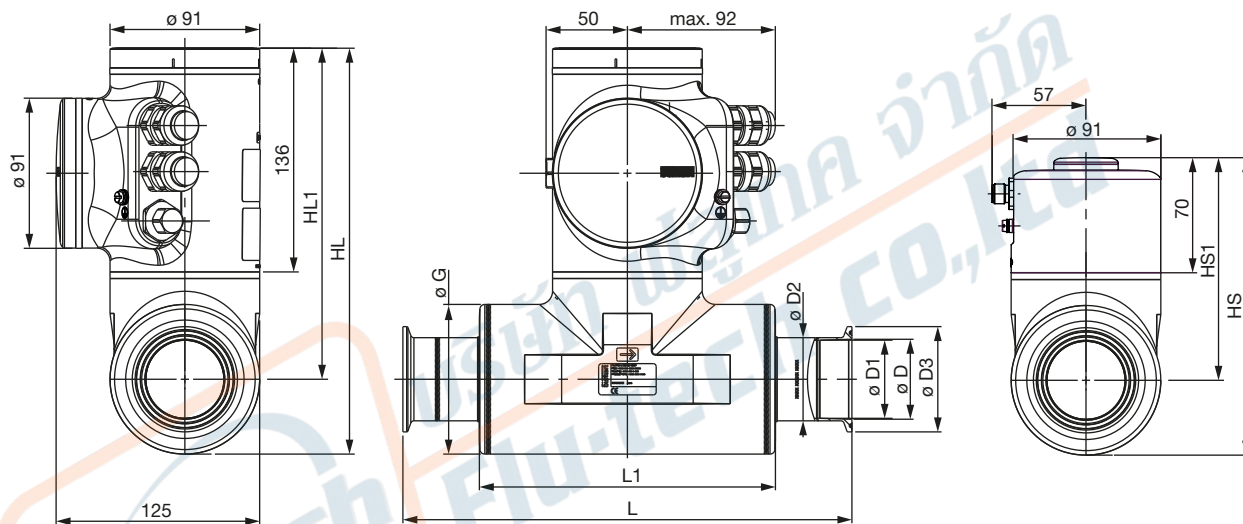

Sensor with process connection  $>$  DN 50/2"

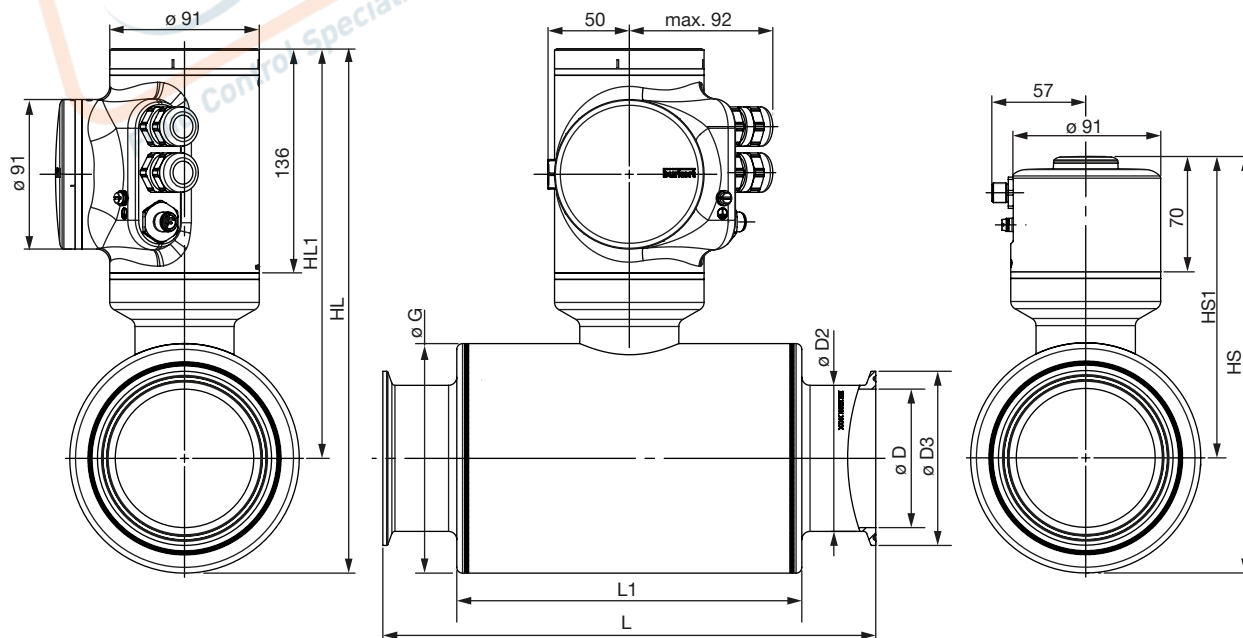

| Clamp/pipe size  |        |     |     |     |     |       |       |       |      |       |     |     |
|--|--------|-----|-----|-----|-----|-------|-------|-------|------|-------|-----|-----|
| [mm]   | [inch] | HL  | HL1 | HS  | HS1 | D1    | D     | D2    | D3   | G     | L1  | L   |
| Clamp according to DIN 32676 series A and process pipe according to DIN 11866 series A (DIN 11850) |        |     |     |     |     |       |       |       |      |       |     |     |
| 08   | –      | 250 | 220 | 184 | 154 | 10    | 10    | 14    | 34   | 60.3  | 105 | 158 |
| 15 <sup>1.)</sup>  | –      | 250 | 220 | 184 | 154 | 15.75 | 16    | 19.05 | 34   | 60.3  | 105 | 166 |
| 25 <sup>1.)</sup>  | –      | 250 | 220 | 184 | 154 | 22.1  | 26    | 25.4  | 50.5 | 60.3  | 105 | 236 |
| 40 <sup>1.)</sup>  | –      | 250 | 200 | 184 | 134 | 34.8  | 38    | 38.1  | 50.5 | 91    | 180 | 326 |
| 50 <sup>1.)</sup>  | –      | 250 | 200 | 184 | 134 | 47.5  | 50    | 50.8  | 64   | 91    | 180 | 306 |
| 65   | –      | 321 | 251 | 255 | 185 | 66    | 66    | 70    | 91   | 139.7 | 210 | 300 |
| 80   | –      | 321 | 251 | 255 | 185 | 81    | 81    | 85    | 106  | 139.7 | 210 | 300 |
| Clamp according to DIN 32676 series B and process pipe according to DIN 11866 series B (ISO 1127)  |        |     |     |     |     |       |       |       |      |       |     |     |
| 08   | –      | 250 | 220 | 184 | 154 | 10.3  | 10.3  | 14    | 25   | 60.3  | 105 | 158 |
| 15   | –      | 250 | 220 | 184 | 154 | 18.1  | 18.1  | 21.3  | 50.5 | 60.3  | 105 | 168 |
| 15 <sup>2.)</sup>  | –      | 250 | 220 | 184 | 154 | 18.1  | 18.1  | 21.3  | 34   | 60.3  | 105 | 168 |
| 25   | –      | 250 | 220 | 184 | 154 | 29.7  | 29.7  | 33.7  | 50.5 | 60.3  | 120 | 175 |
| 40   | –      | 250 | 200 | 184 | 134 | 44.3  | 44.3  | 48.3  | 64   | 91    | 180 | 273 |
| 50   | –      | 250 | 200 | 184 | 134 | 56.3  | 56.3  | 60.3  | 77.5 | 91    | 180 | 273 |
| 65   | –      | 321 | 251 | 255 | 185 | 72.1  | 72.1  | 76.1  | 91   | 139.7 | 210 | 300 |
| 80   | –      | 321 | 251 | 255 | 185 | 84.3  | 84.3  | 88.9  | 106  | 139.7 | 210 | 300 |
| Clamp according to DIN 32676 series C and process pipe according to DIN 11866 series C (ASME BPE)  |        |     |     |     |     |       |       |       |      |       |     |     |
| –  | ¾      | 250 | 220 | 184 | 154 | 7.75  | 7.75  | 14    | 25   | 60.3  | 105 | 158 |
| –  | ½      | 250 | 220 | 184 | 154 | 9.4   | 9.4   | 14    | 25   | 60.3  | 105 | 158 |
| –  | ¾      | 250 | 220 | 184 | 154 | 15.75 | 15.75 | 19.05 | 25   | 60.3  | 105 | 143 |
| –  | 1      | 250 | 220 | 184 | 154 | 22.1  | 22.1  | 25.4  | 50.5 | 60.3  | 105 | 143 |
| –  | 1½     | 250 | 200 | 184 | 134 | 34.8  | 34.8  | 38.1  | 50.5 | 91    | 180 | 273 |
| –  | 2      | 250 | 200 | 184 | 134 | 47.5  | 47.5  | 50.8  | 64   | 91    | 180 | 273 |
| –  | 2½     | 321 | 251 | 255 | 185 | 60.2  | 60.2  | 63.5  | 77.5 | 139.7 | 210 | 300 |
| –  | 3      | 321 | 251 | 255 | 185 | 72.9  | 72.9  | 76.2  | 91   | 139.7 | 210 | 300 |
| Clamp according to SMS 3017 and process pipe according to SMS 3008                                 |        |     |     |     |     |       |       |       |      |       |     |     |
| 25 <sup>1.)</sup>  | –      | 250 | 220 | 184 | 154 | 22.1  | 22.6  | 25.4  | 50.5 | 60.3  | 105 | 143 |
| 40 <sup>1.)</sup>  | –      | 250 | 200 | 184 | 134 | 34.8  | 35.6  | 38.1  | 50.5 | 91    | 180 | 273 |
| 50 <sup>1.)</sup>  | –      | 250 | 200 | 184 | 134 | 47.5  | 48.6  | 50.8  | 64   | 91    | 180 | 273 |

1.) DIN 32676 series A and SMS 3017 based on ASME BPE pipe dimension with adapted concentric clamp design


Design according to EHEDG DOC8 guidelines

2.) Similar to DIN 32676 series B but with clamp 34.0

#### 4.5. Flowmeter with aseptic collar flange (BF)

##### Note:

- Specifications in mm (unless specified differently)
- Aseptic collar flange (BF) according to DIN 11864-2 form A series A, B or C

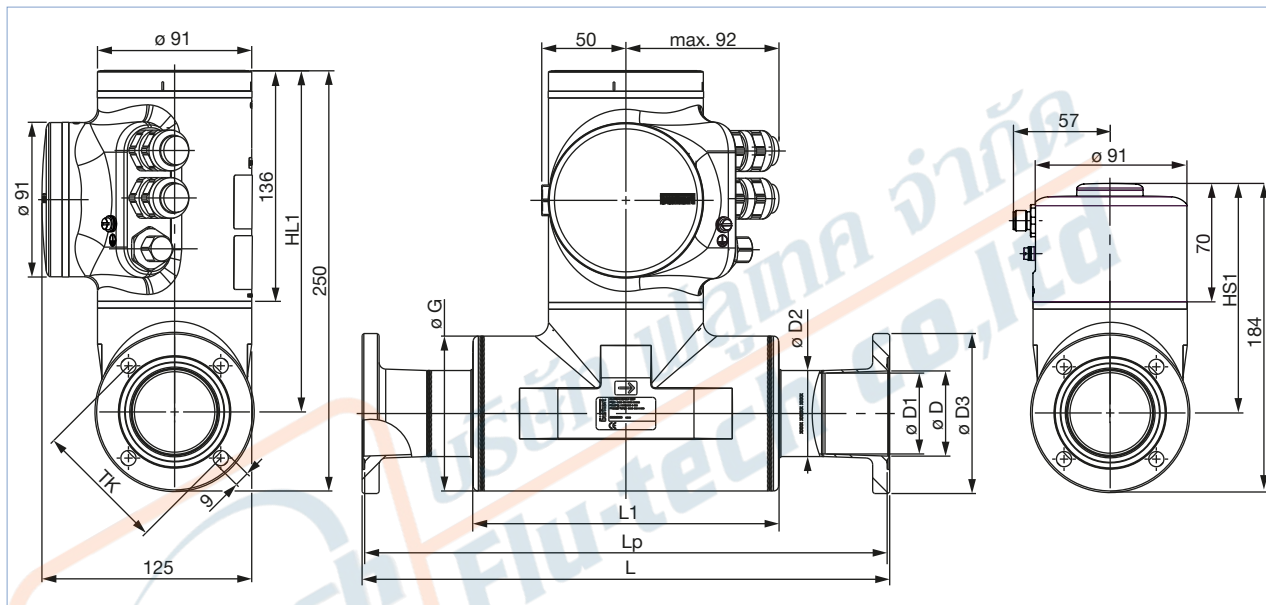

| Flange/pipe size   |        |     |     |    |       |       |       |     |      |     |     |     |
|--|--------|-----|-----|----|-------|-------|-------|-----|------|-----|-----|-----|
| [mm]   | [inch] | HL1 | HS1 | TK | D1    | D     | D2    | D3  | G    | L1  | Lp  | L   |
| <b>Flange according to DIN 11864-2 series A and process pipe according to DIN 11866 series A (DIN 11850)</b> |        |     |     |    |       |       |       |     |      |     |     |     |
| 15 <sup>1.)</sup>  | –      | 220 | 154 | 42 | 15.75 | 16    | 19.05 | 59  | 60.3 | 105 | 163 | 166 |
| 25 <sup>1.)</sup>  | –      | 220 | 154 | 53 | 22.1  | 26    | 25.4  | 70  | 60.3 | 105 | 237 | 240 |
| 40 <sup>1.)</sup>  | –      | 200 | 134 | 65 | 34.8  | 38    | 38.1  | 82  | 91   | 180 | 327 | 330 |
| 50 <sup>1.)</sup>  | –      | 200 | 134 | 77 | 47.5  | 50    | 50.8  | 94  | 91   | 180 | 307 | 310 |
| <b>Flange according to DIN 11864-2 series B and process pipe according to DIN 11866 series B (ISO 1127)</b>  |        |     |     |    |       |       |       |     |      |     |     |     |
| 08   | –      | 220 | 154 | 37 | 10.3  | 10.3  | 14    | 54  | 60.3 | 105 | 155 | 158 |
| 15   | –      | 220 | 154 | 45 | 18.1  | 18.1  | 21.3  | 62  | 60.3 | 105 | 170 | 173 |
| 25   | –      | 220 | 154 | 57 | 29.7  | 29.7  | 33.7  | 74  | 60.3 | 120 | 187 | 190 |
| 40   | –      | 200 | 134 | 71 | 44.3  | 44.3  | 48.3  | 88  | 91   | 180 | 275 | 278 |
| 50   | –      | 200 | 134 | 85 | 56.3  | 56.3  | 60.3  | 103 | 91   | 180 | 262 | 265 |
| <b>Flange according to DIN 11864-2 series C and process pipe according to DIN 11866 series C (ASME BPE)</b>  |        |     |     |    |       |       |       |     |      |     |     |     |
| –  | ½      | 220 | 154 | 37 | 9.4   | 9.4   | 14    | 54  | 60.3 | 105 | 155 | 158 |
| –  | ¾      | 220 | 154 | 42 | 15.75 | 15.75 | 19.05 | 59  | 60.3 | 105 | 168 | 171 |
| –  | 1      | 220 | 154 | 49 | 22.1  | 22.1  | 25.4  | 66  | 60.3 | 105 | 165 | 168 |
| –  | 1½     | 200 | 134 | 62 | 34.8  | 34.8  | 38.1  | 79  | 91   | 180 | 275 | 278 |
| –  | 2      | 200 | 134 | 75 | 47.5  | 47.5  | 50.8  | 92  | 91   | 180 | 275 | 278 |


1.) DIN 11864-2 series A based on ASME BPE pipe dimension with adapted concentric clamp design

Design according to EHEDG DOC8 guidelines

#### 4.6. Flowmeter with aseptic collar clamp (BKS)

##### Note:

- Specifications in mm (unless specified differently)
- Aseptic collar clamp (BKS) according to DIN 11864-3 form A series A, B or C

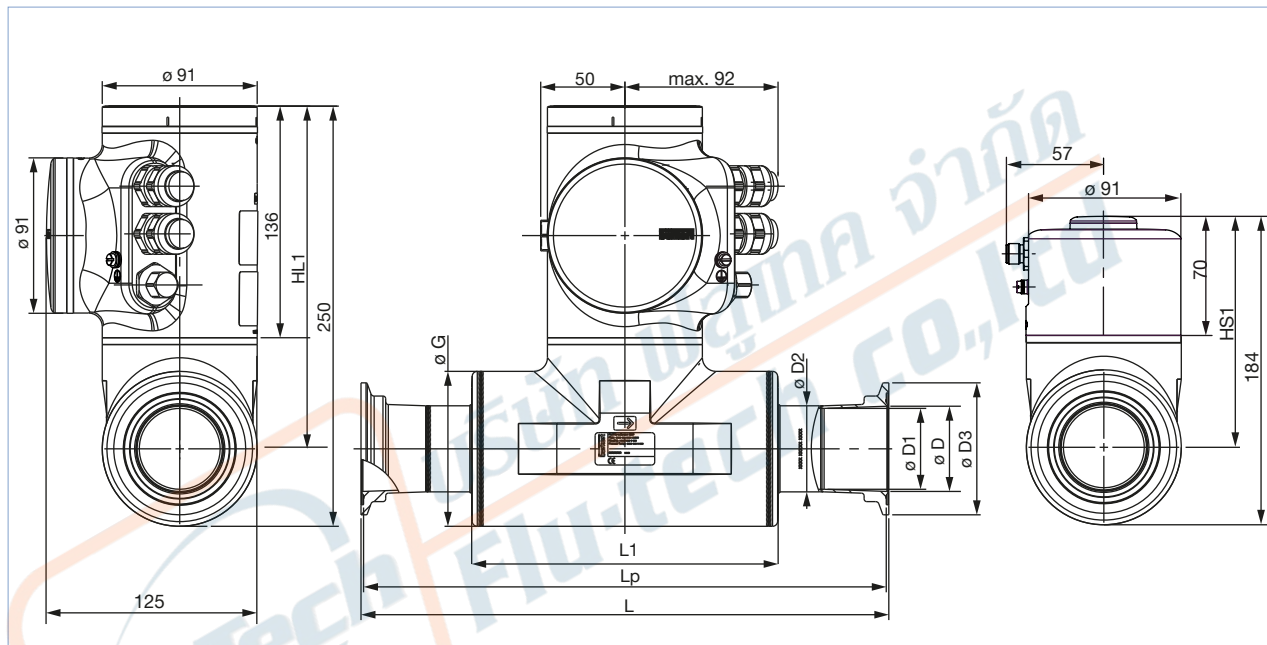

| Clamp/pipe size   |        |     |     |       |       |       |      |      |     |     |     |
|---|--------|-----|-----|-------|-------|-------|------|------|-----|-----|-----|
| [mm]  | [inch] | HL1 | HS1 | D1    | D     | D2    | D3   | G    | L1  | Lp  | L   |
| <b>Clamp according to DIN 11864-3 series A and process pipe according to DIN 11866 series A (DIN 11850)</b> |        |     |     |       |       |       |      |      |     |     |     |
| 15 <sup>1.)</sup>   | -      | 220 | 154 | 15.75 | 16    | 19.05 | 34   | 60.3 | 105 | 163 | 166 |
| 25 <sup>1.)</sup>   | -      | 220 | 154 | 22.1  | 26    | 25.4  | 50.5 | 60.3 | 105 | 237 | 240 |
| 40 <sup>1.)</sup>   | -      | 200 | 134 | 34.8  | 38    | 38.1  | 64   | 91   | 180 | 327 | 330 |
| 50 <sup>1.)</sup>   | -      | 200 | 134 | 47.5  | 50    | 50.8  | 77.5 | 91   | 180 | 307 | 310 |
| <b>Clamp according to DIN 11864-3 series B and process pipe according to DIN 11866 series B (ISO 1127)</b>  |        |     |     |       |       |       |      |      |     |     |     |
| 08  | -      | 220 | 154 | 10.3  | 10.3  | 14    | 34   | 60.3 | 105 | 155 | 158 |
| 15  | -      | 220 | 154 | 18.1  | 18.1  | 21.3  | 34   | 60.3 | 105 | 166 | 169 |
| 25  | -      | 220 | 154 | 29.7  | 29.7  | 33.7  | 50.5 | 60.3 | 120 | 187 | 190 |
| 40  | -      | 200 | 134 | 44.3  | 44.3  | 48.3  | 64   | 91   | 180 | 277 | 280 |
| 50  | -      | 200 | 134 | 56.3  | 56.3  | 60.3  | 91   | 91   | 180 | 268 | 271 |
| <b>Clamp according to DIN 11864-3 series C and process pipe according to DIN 11866 series C (ASME BPE)</b>  |        |     |     |       |       |       |      |      |     |     |     |
| -   | ½      | 220 | 154 | 9.4   | 9.4   | 14    | 34   | 60.3 | 105 | 155 | 158 |
| -   | ¾      | 220 | 154 | 15.75 | 15.75 | 19.05 | 34   | 60.3 | 105 | 164 | 167 |
| -   | 1      | 220 | 154 | 22.1  | 22.1  | 25.4  | 50.5 | 60.3 | 105 | 161 | 164 |
| -   | 1½     | 200 | 134 | 34.8  | 34.8  | 38.1  | 64   | 91   | 180 | 275 | 278 |
| -   | 2      | 200 | 134 | 47.5  | 47.5  | 50.8  | 77.5 | 91   | 180 | 276 | 279 |


1.) DIN 11864-3 series A based on ASME BPE pipe dimension with adapted concentric clamp design  
Design according to EHEDG DOC8 guidelines



#### 4.7. Flowmeter with thread connection

##### Note:

- Specifications in mm (unless specified differently)
- Thread connection according to DIN 11851 series A

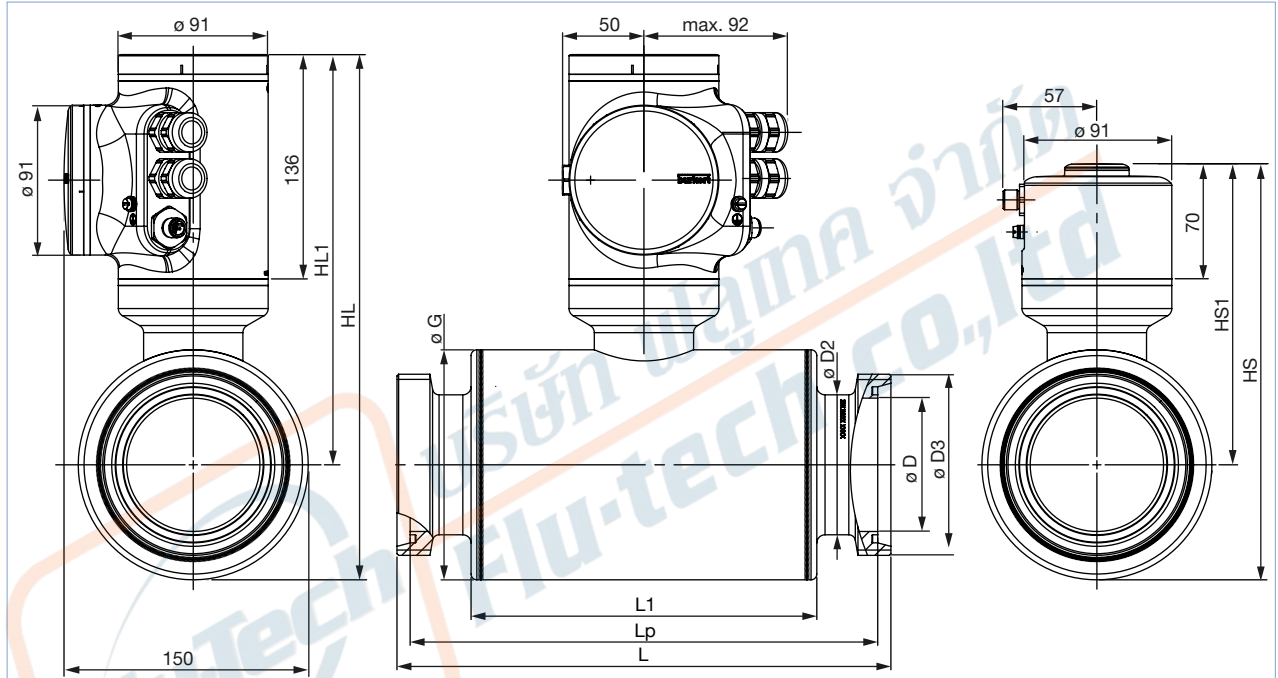


| Thread/pipe size              |     |     |     |     |    |    |                   |       |     |     |     |  |
|-------------------------------|-----|-----|-----|-----|----|----|-------------------|-------|-----|-----|-----|--|
| [mm]                          | HL  | HL1 | HS  | HS1 | D  | D2 | D3 <sup>1.)</sup> | G     | L1  | Lp  | L   |  |
| Thread according to DIN 11851 |     |     |     |     |    |    |                   |       |     |     |     |  |
| 65                            | 321 | 251 | 255 | 185 | 66 | 70 | Rd 95 x 1/6       | 139.7 | 210 | 284 | 300 |  |
| 80                            | 321 | 251 | 255 | 185 | 81 | 85 | Rd 110 x 1/4      | 139.7 | 210 | 284 | 300 |  |

1.) Thread according to DIN 405-1

## 5. Performance specifications

### 5.1. Medium temperature

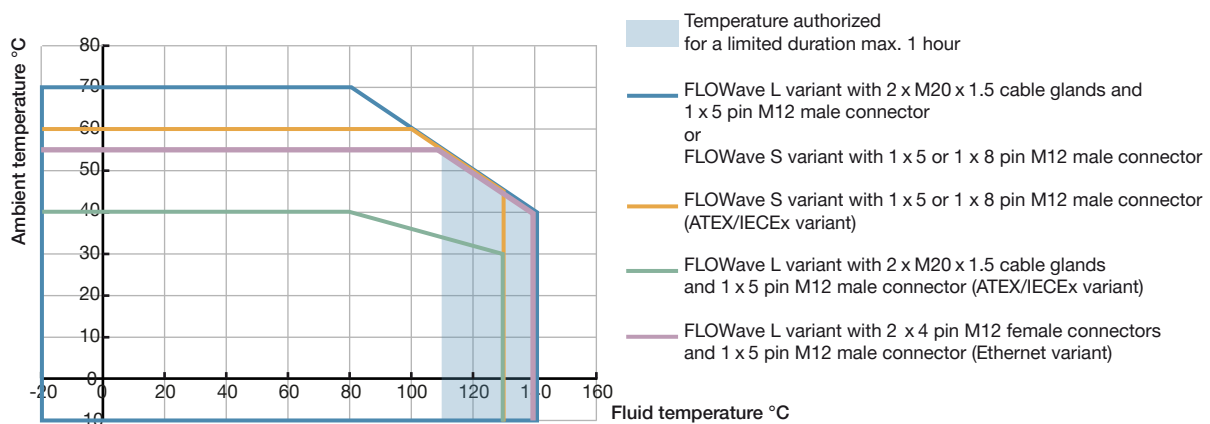

Visit product website ►

25 | 43



บริษัท ฟลูเทค จำกัด  
FLU-TECH CO.,LTD

845/3-4 หมู่ 3 ถ.เทพารักษ์ ต.เทพารักษ์ อ.เมือง จ.สมุทรปราการ 10270  
845/3-4 Thepharak RD., T.Thepharak, A.Muang, Samutprakarn 10270 THAILAND  
Tel. 0 2384 6060, Fax 0 2384 5701, Email : sales@flutech.co.th, www.flutech.co.th

## 5.2. Measurement deviation

### Note:

- This table shows the measurement deviations according to the pipe connection standards per measuring range.
- In the following table, the term “full scale” refers to full scale of volume flow rate, i.e. the flow rate corresponding to 10 m/s flow velocity.

| DN        | Pipe standard         | Flow velocity in sensor tube<br>in [m/s]<br>in % of full scale | 0.1<br>1                        | 1<br>10                           | 10<br>100 |
|-----------|-----------------------|--|---------------------------------|-----------------------------------|-----------|
| ⅝"        | ASME BPE              | Volume flow rate range [m³/h]                                  | 0.017<br>± 0.08 % of full scale | 0.17<br>± 0.4 % of measured value | 1.7       |
| ½"        | ASME BPE              | Volume flow rate range [m³/h]                                  | 0.025<br>± 0.08 % of full scale | 0.25<br>± 0.4 % of measured value | 2.5       |
| 08        | ISO 1127<br>DIN 11850 | Volume flow rate range [m³/h]                                  | 0.03<br>± 0.08 % of full scale  | 0.30<br>± 0.4 % of measured value | 3         |
| ¾"<br>15  | ASME BPE<br>DIN 11850 | Volume flow rate range [m³/h]                                  | 0.07<br>± 0.08 % of full scale  | 0.7<br>± 0.4 % of measured value  | 7         |
| 15        | ISO 1127              | Volume flow rate range [m³/h]                                  | 0.10<br>± 0.08 % of full scale  | 1.0<br>± 0.4 % of measured value  | 10        |
| 1"<br>25  | ASME BPE<br>DIN 11850 | Volume flow rate range [m³/h]                                  | 0.14<br>± 0.08 % of full scale  | 1.4<br>± 0.4 % of measured value  | 14        |
| 25<br>25  | SMS 3008              | Volume flow rate range [m³/h]                                  | 0.25<br>± 0.08 % of full scale  | 2.5<br>± 0.4 % of measured value  | 25        |
| 25        | ISO 1127              | Volume flow rate range [m³/h]                                  | 0.25<br>± 0.08 % of full scale  | 2.5<br>± 0.4 % of measured value  | 25        |
| 1½"<br>40 | ASME BPE<br>DIN 11850 | Volume flow rate range [m³/h]                                  | 0.35<br>± 0.08 % of full scale  | 3.5<br>± 0.4 % of measured value  | 35        |
| 40<br>40  | SMS 3008              | Volume flow rate range [m³/h]                                  | 0.56<br>± 0.08 % of full scale  | 5.6<br>± 0.4 % of measured value  | 56        |
| 40        | ISO 1127              | Volume flow rate range [m³/h]                                  | 0.56<br>± 0.08 % of full scale  | 5.6<br>± 0.4 % of measured value  | 56        |
| 2"<br>50  | ASME BPE<br>DIN 11850 | Volume flow rate range [m³/h]                                  | 0.64<br>± 0.08 % of full scale  | 6.4<br>± 0.4 % of measured value  | 64        |
| 50<br>50  | SMS 3008              | Volume flow rate range [m³/h]                                  | 0.90<br>± 0.08 % of full scale  | 9.0<br>± 0.4 % of measured value  | 90        |
| 50        | ISO 1127              | Volume flow rate range [m³/h]                                  | 0.90<br>± 0.08 % of full scale  | 9.0<br>± 0.4 % of measured value  | 90        |
| 2½"       | ASME BPE              | Volume flow rate range [m³/h]                                  | 1.02<br>± 0.08 % of full scale  | 10.2<br>± 0.4 % of measured value | 102       |
| 65        | DIN 11850             | Volume flow rate range [m³/h]                                  | 1.23<br>± 0.08 % of full scale  | 12.3<br>± 0.4 % of measured value | 123       |
| 65        | ISO 1127              | Volume flow rate range [m³/h]                                  | 1.47<br>± 0.08 % of full scale  | 14.7<br>± 0.4 % of measured value | 147       |
| 3"        | ASME BPE              | Volume flow rate range [m³/h]                                  | 1.50<br>± 0.08 % of full scale  | 15.0<br>± 0.4 % of measured value | 150       |
| 80        | DIN 11850             | Volume flow rate range [m³/h]                                  | 1.85<br>± 0.08 % of full scale  | 18.5<br>± 0.4 % of measured value | 185       |
| 80        | ISO 1127              | Volume flow rate range [m³/h]                                  | 2.00<br>± 0.08 % of full scale  | 20.0<br>± 0.4 % of measured value | 200       |

## 5.3. Refresh time

| Selectable mode | Volume flow rate | Density | Mass flow rate |
|-----------------|------------------|---------|----------------|
| Very short      | ~ 25 ms          | 1 s     | ~ 25 ms        |
| Short           | ~ 40 ms          | 1 s     | ~ 40 ms        |
| Long            | ~ 75 ms          | 0.5 s   | ~ 75 ms        |

## 6. Product installation

### 6.1. Installation notes

#### Note:

The flowmeter is not designed for gas and steam flow measurement. However, their flow does not have any negative effect on the device or its operation. Other liquids flowing through again afterwards are measured correctly as before.

The factory calibration of the FLOWave is done under reference conditions with inlet (40 x DN) and outlet (1 x DN) distances and the appropriate internal diameter of the pipes.

Deviation from reference conditions can be easily adjusted through the use of a built-in K factor adjustment or Teach in procedure. We can support you if necessary, please do not hesitate to contact us.

The device can be installed into either horizontal, oblique or vertical pipes. But an installation on a vertical pipe will be better to prevent air or gas bubbles inside the measurement area. **For proper operation always ensure a totally filled measurement tube.**

Conformity to 3A and EHEDG requires an angle of at least 5° (for SMS or series A connections) or 3° (all others available connections) against horizontal to ensure complete draining however this not necessary for proper operation of the FLOWave.

The suitable pipe size can be selected using the diagram for selecting the nominal diameter of the pipe. See chapter "6.2. Selection of the nominal diameter" on page 27.

### 6.2. Selection of the nominal diameter

The graph is used to determine the DN of the pipe and the flowmeter appropriate to the application, according to the fluid velocity and the flow rate. On the chart, the intersection of flow rate and flow velocity gives the appropriate diameter.

#### Example 1:


Flowmeter with process connection according to DIN 32676 series B (pipe ISO 1127) or DIN 11864-2 form A series B (pipe ISO 1127)

- Flow: 10 m<sup>3</sup>/h
  - Optimal flow rate: 1...3 m/s
- Result: Select a pipe size of DN 40 or DN 50

#### Example 2:

Flowmeter with process connection according to DIN 32676 series A (pipe DIN 11850) or DIN 11864-2 series A (pipe DIN 11850)


- Flow: 10 m<sup>3</sup>/h
  - Optimal flow rate: 1...3 m/s
- Result: Select a pipe size of DN 40 or DN 50

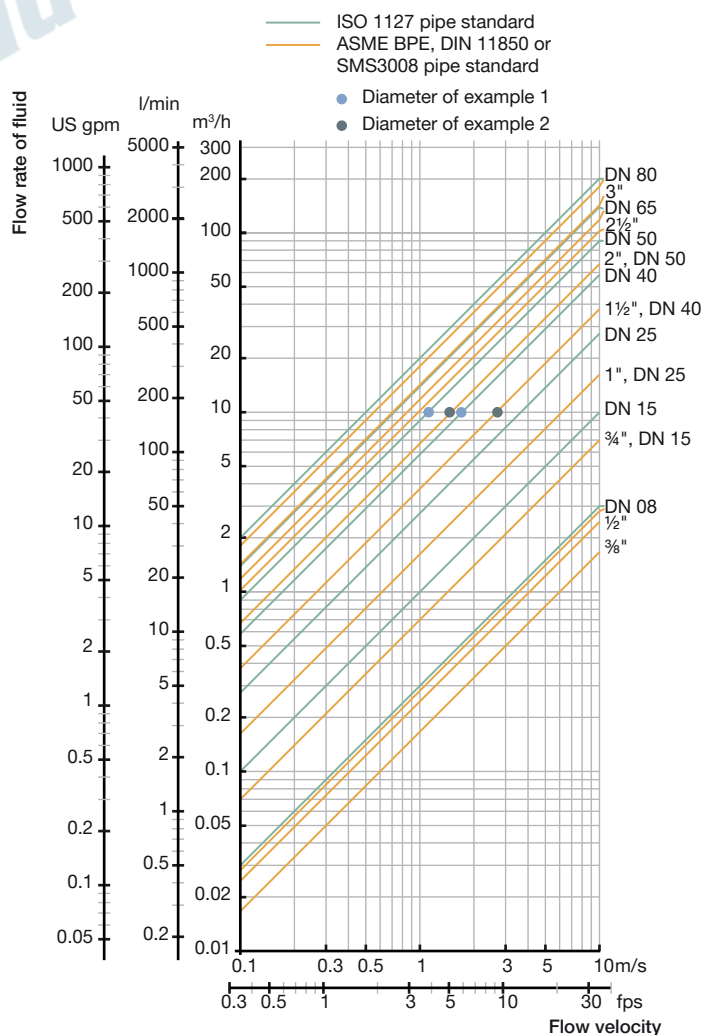

### 6.3. Mounting options


#### FLOWave L flowmeter

The product is delivered as described in position 1 in the picture below. The position of the transmitter can be changed in 90° steps. The position of the display module and the blind cover can also be changed in steps of 90° both on the top of the unit and on the front face.

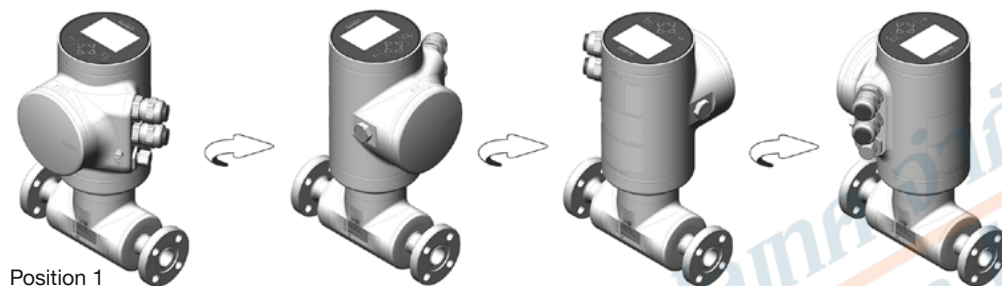

Position 1

For safety reasons the display module and blind cover on the top or front are locked. The display module and blind cover can be unlocked with a magnetic key which is included in the delivery of each device.

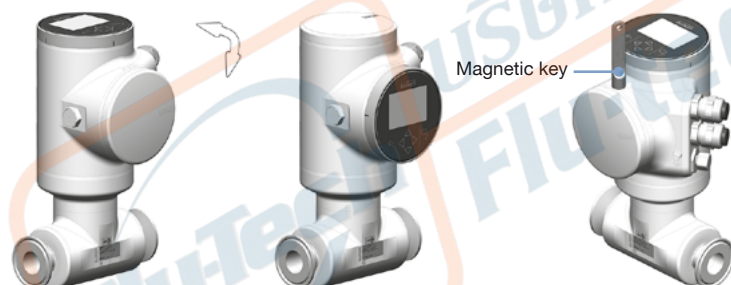

#### FLOWave S flowmeter

The product is delivered as described in position 1 in the picture below. The position of the transmitter can be changed in 90° steps. For safety reasons the transmitter is locked. The transmitter can be unlocked with a magnetic key which is included in the delivery of each device.



Position 1



## 7. Product operation


### 7.1. Measuring principle

The technology used is based on SAW (Surface Acoustic Waves). The type of wave propagation is similar to what happens when an earthquake occurs in nature.

In the case of FLOWave it is a miniaturized signal, not running on the surface of the earth but on a measurement tube. FLOWave uses so called interdigital transducers which are placed on flattened areas of the tube surface. Each one acts as emitter as well as receiver. Two of them (nos. 1 and 4) emit forward, in the direction of the liquid flow, the others (nos. 2 and 3) backwards, i.e. in the opposite direction to the direction of flow. The propagation time is measured from emitter to receiver. The difference between the forward and backward propagation time of the waves is proportional to the volume flow rate.

The high performance measurement is achieved by the following aspects:

- Each emitter sends multiple signals that are received on two other receivers
- The results are based on the reception of the signals that pass through the liquid one or more times.
- Several measurements can be performed based on the collected information. Many properties of the liquid can be derived, including the flow velocity, the fluid density, the fraction of the transmitted signal ("acoustic transmission factor"), and the so-called "differentiation factor" (see following), as well as information about the presence of gas bubbles or solid parts.
- Mass flow is calculated from fluid density and volume flow.
- Mass flow and density measurements are an option on standard FLOWave flowmeters, which requires adjustment and calibration during manufacture. It is therefore necessary to specify whether or not the device is to be equipped with these features when ordering the device.

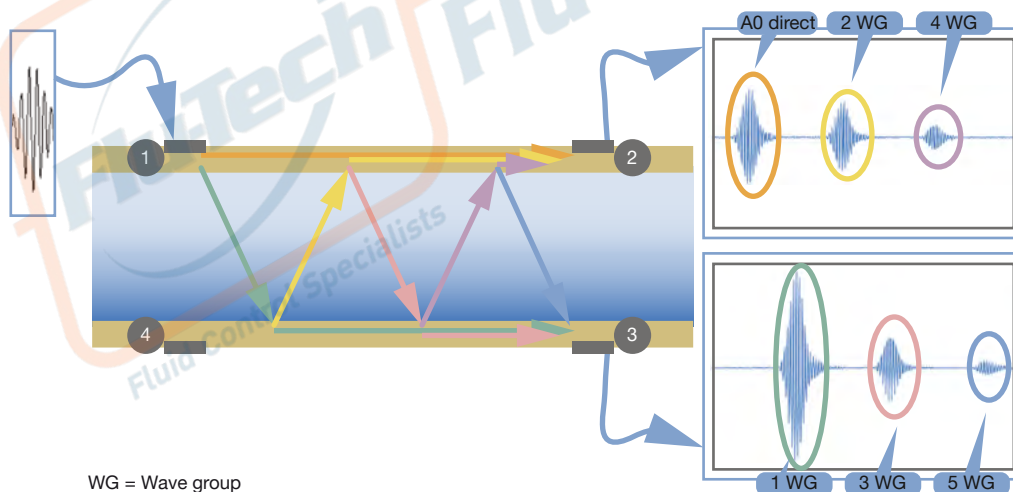

This figure shows, as an example, the reception signals when interdigital transducer 1 is transmitting. The emitter excitation produces the SAW with a frequency of more than 1 MHz.

As a result of the emission of these waves, the following effects occur:

- A wave propagates along the surface of the tube (see orange line).
- A wave is emitted (see green line) and passes through the liquid towards the opposite side of the tube at a certain angle, which depends mainly on the speed of propagation on the surface of the tube and in the liquid.
- Upon reaching the opposite side of the tube, two effects take place.
  - A wave is triggered in the tube and propagates (see green line) to receiver 3
  - A wave is triggered in the liquid (see yellow line) and passes through it again to the opposite wall of the tube. The analysis of the transmitted and received waves allows deriving the process values (velocity, density, flow rates).

These effects are repeated and thus generate the many signals received, which are differentiated in the image with different colours.

## 7.2. Special functions

### Note:

DF, ATF, concentration, density and mass flow features must be selected upon initial order of device.

For the detection of gas bubbles and solid particles the device (from firmware version 01.05.00) includes a so called “acoustic transmission factor (ATF)” with a measurement range of 5...120 %, whose value is constantly recorded and directly influenced by the presence of gas bubbles and solid particles.

A “differentiation factor (DF)”, with a measuring range of 0.8...1.3, is available for the detection and differentiation of liquids. This continuously measured value, which uses water as a reference fluid, is temperature-compensated and so its value is representative in a tight value range for each liquid. The changes in value of this process measurement enable differentiation between different liquids.

Before SW version 05.00.00, the differentiation factor was named density factor. As the density option has been added, the name has been changed to avoid confusion.

One or two concentration measurements, based on fluid acoustic properties, are available as an option.

If a “concentration” option is ordered, the product will be delivered by default with the following concentration measurements, depending of the activated options:

| Measured concentration |                              | Range of concentration   | Range of temperature | Option needed                  |
|------------------------|------------------------------|--|----------------------|--------------------------------|
| Quantity of            | In mixture consisting of     |  |                      |                                |
| Saccharose             | Water + saccharose           | 0...70 °Brix   | 4...90 °C            | DF + concentration 1           |
| Ethanol                | Ethanol + water              | 40...100 % w/w (mass ratio)                                    | 10...70 °C           | DF + concentration 1           |
| Saccharose             | Ethanol + water + saccharose | Saccharose: 0...15 °Brix<br>Ethanol: 0...15 % w/w (mass ratio) | 4...40 °C            | DF + density + concentration 1 |
| Ethanol                | Ethanol + water + saccharose | Saccharose: 0...15 °Brix<br>Ethanol: 0...15 % w/w (mass ratio) | 4...40 °C            | DF + density + concentration 1 |

To be able to monitor two concentrations simultaneously, options concentration 1 and concentration 2 must be activated.

## 8. Product design and assembly


### 8.1. Product assembly

The 8098 flowmeter consists of a S097 flow sensor and a SE98 transmitter (FLOWave L flowmeter) or SE91 transmitter (FLOWave S flowmeter).

The flow sensor includes the measurement tube equipped with interdigital transducers, the sensor housing and the process connections in accordance to the standards ISO, ASME BPE, DIN, SMS. At present the sensor size ranges from DN 08 to DN 80 or from 3/8" to 3".

The FLOWave L flowmeter is available with or without display. The high resolution display includes a capacitive working keypad for all interactive user actions, guided by a user friendly menu system. The output signals include one analogue output and one digital output; while a third output signal can be switched between analogue and digital through parametrisation. Electrical connection is done on push-in connectors via two cable glands and/or one M12 connector.

The FLOWave S flowmeter is only available without display. The electrical connection is made via an M12 connector.

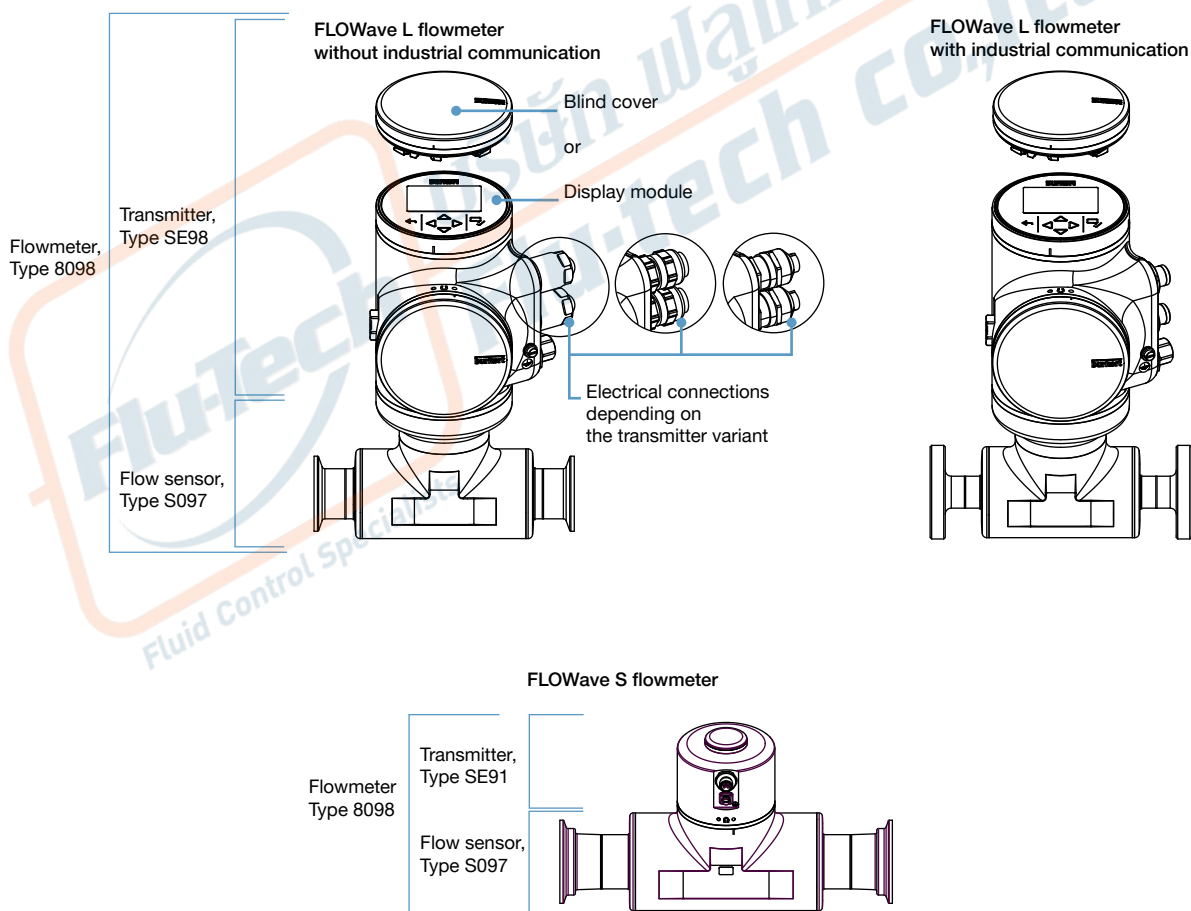


## 9. Product accessories

### Note:

To set up a device without a display, please use the USB-büS interface, Type 8923, the Bürkert Communicator Type 8920. For the FLOWave S with two outputs, the büS adaptor cable article no. 773286 is required too.

See **Software manual Type 8920** ► for more information.

| Accessories   | No. | Description  |
|---|-----|--|
|  | 1   | Quick-Start  |
|   | 2   | Power supply: 100...240 V AC/ 24 V DC 1 A and adaptors for power supply worldwide use                |
|   | 3   | büS terminating resistor on büS Y-splitter   |
|   | 4   | 5 pin M12 male connector wired on free end cable   |
|   | 5   | büS connection cable with 5 pin M12 plug, micro USB B plug   |
|   | 6   | büS adapter with 5 pin M12 plug, A-coded to 5 pin M12 plug, A-coded                                  |
|   | 7   | büS stick (USB to büS/CANopen adaptor)   |
|   | 8   | büS service cable with 5 pin M12 plug, mini USB and circular plug-in connectors for power supply     |
|   | 9   | Magnetic key   |
|   | 10  | CD - Communicator (30-day license without registration, update and licensing over Bürkert home page) |

## 10. Ordering information

### 10.1. Bürkert eShop – Easy ordering and quick delivery



#### Bürkert eShop – Easy ordering and fast delivery

You want to find your desired Bürkert product or spare part quickly and order directly? Our online shop is available for you 24/7. Sign up and enjoy all the benefits.


[Order online now](#)

### 10.2. Recommendation regarding product selection




#### Note:

- The installation of the flowmeter in a pipe requires the use of counter-connection, seals, fixing elements, etc. depending on the used norm.
- The drawings show the installation with a standard variant of the flow meter. The installation is also valid for the compact variant.


For instance with middle-sized devices:
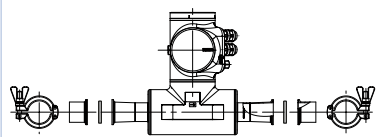
| Connection  | Description  |
|---|--|
|  | <p><b>With clamp according to DIN 32676 series A</b></p> <p>To insert a FLOWave DN 40 with clamps according to DIN 32676 series A (with Ra &lt; 0.8 µm) to a pipe according to DIN 11866 series A (DIN 11850), the <b>correct adapters to be selected and separately ordered</b> are for instance</p> <ul style="list-style-type: none"> <li>• 2 x <b>BBS-25</b> clamp ferrules, Article no. 747237, see <b>data sheet Type BBS-25</b> ► for more information</li> <li>• 2 x the appropriate seals (not provided)</li> <li>• 2 x the corresponding clamps, Article no. 731164</li> </ul> |



| Connection  | Description  |
|---|--|
|  | <p><b>With aseptic collar flange (BF) according to DIN 11864-2 form A</b><br/>To insert a FLOWave DN 40 with collar flanges according to DIN 11864-2 series B (with Ra &lt; 0.8 µm) to a pipe according to DIN 11866 series B (ISO 1127), the <b>correct adapters to be selected and separately ordered</b> are for instance</p> <ul style="list-style-type: none"> <li>• 2 x <b>BBS-06</b> aseptic groove flange, Article no. 731860, see <b>data sheet Type BBS-06</b> ► for more information</li> <li>• 2 x the appropriate seals (not provided)</li> <li>• 8 x the corresponding screws, flat washers and nuts (please refer to the DIN 11864-2 standard)</li> </ul> |
|  | <p><b>With aseptic collar clamp (BKS) according to DIN 11864-3 form A</b><br/>To insert a FLOWave 1" with hygienic collar clamps according to DIN 11864-3 series C (with Ra &lt; 0.8 µm) to a pipe according to DIN 11866 series C (ASME BPE), the <b>correct adapters to be selected and separately ordered</b> are for instance</p> <ul style="list-style-type: none"> <li>• 2 x <b>BBS-05</b> aseptic groove clamp, Article no. 730272, see <b>data sheet Type BBS-05</b> ► for more information</li> <li>• 2 x the appropriate seals (not provided)</li> <li>• 2 x the corresponding clamps, Article no. 731164</li> </ul>   |
|  | <p><b>With thread according to DIN 11851</b><br/>To insert a FLOWave with thread according to DIN 11851 series A to a pipe according to DIN 11850, suitable adapters (not available from Bürkert) are required, for instance</p> <ul style="list-style-type: none"> <li>• 2 x the conical ferrule</li> <li>• 2 x the appropriate DIN 11851 seal</li> <li>• 2 x the corresponding round slotted nut</li> </ul>  |

### 10.3. Bürkert product filter

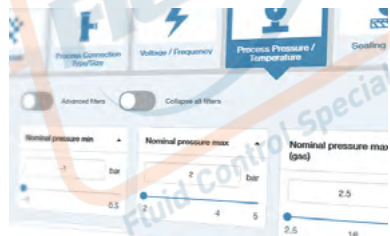


**Bürkert product filter – Get quickly to the right product**

You want to select products comfortably based on your technical requirements? Use the Bürkert product filter and find suitable articles for your application quickly and easily.


[Try out our product filter](#)

### 10.4. Bürkert 3D Model - Interactive Animation

**Applications & Tools**



CAD Model



Interactive Animation

**Bürkert 3D Model - Interactive Animation**

3D Model and Interactive Animation are available on the website of the flowmeter Type 8098.

See **website of the Type 8098** ► under “Applications and Tools”.

### 10.5. Ordering chart FLOWave L flowmeter with or without industrial communication

Clamp process connection acc. to DIN 32676 series A for pipe acc. to DIN 11866 series A (DIN 11850)

**Note:**

- To set up a device without a display, please use the USB-büS interface, Type 8923 (has to be ordered separately - see chapter "9. Product accessories" on page 32 and "10.7. Ordering chart accessories" on page 42).
- All these variants are equipped with a display and the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size  | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      | Article no. |
|--|--|-----------------------------------|---|-------------------|----------------|----------------------|-------------|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   | 3A (28-06)     | EHEDG <sup>2.)</sup> |             |
| [mm]   | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            |                |                      |             |
| Variant without industrial communication (2 cable glands <sup>3.)</sup> M20x1.5 + 1 x 5 pin M12 male connector), operating voltage of 12...35 V DC |  |                                   |   |                   |                |                      |             |
| 15   | Ra < 1.6                                   | Ra < 0.8                          | 19.05 x 1.65; 34.0                      | 7                 | Yes            | Yes                  | 569159      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 569161      |
| 25   |  | Ra < 0.8                          | 25.4 x 1.65; 50.5                       | 14                |                |                      | 569163      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 569165      |
| 40   |  | Ra < 0.8                          | 38.1 x 1.65; 50.5                       | 35                |                |                      | 569167      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 569169      |
| 50   |  | Ra < 0.8                          | 50.8 x 1.65; 64.0                       | 64                |                |                      | 569171      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 569173      |
| 65   |  | Ra < 0.8                          | 70.0 x 2.0; 91.0                        | 123               |                |                      | 573445      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 573373      |
| 80   |  | Ra < 0.8                          | 85.0 x 2.0; 106.0                       | 185               |                |                      | 573446      |
|  |  | Ra < 0.4                          |   |                   |                |                      | 573374      |

1.) D2 for holder, s = thickness and D3 for clamp

















2.) The EHEDG compliance is only if used in combination with gaskets from Combifit International B.V.

3.) Cable gland in nickel plated brass valid

Clamp process connection acc. to DIN 32676 series B for pipe acc. to DIN 11866 series B (ISO 1127)

**Note:**

- To set up a device without a display, please use the USB-büS interface, Type 8923 (has to be ordered separately - see chapter "9. Product accessories" on page 32 and "10.7. Ordering chart accessories" on page 42).
- All these variants are equipped with a display and the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size   | Surface quality                            |                                   | Dimensions <sup>1)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                     | Article no.  |  |
|---|--|-----------------------------------|--|-------------------|----------------|---------------------|--|--|
|   | Housing, outer surface of measurement tube | Inner surface of measurement tube |  |                   |                |                     |  |  |
| [mm]  | [µm]                                       | [µm]                              | [mm]                                   | [m³/h]            | 3A (28-06)     | EHEDG <sup>2)</sup> |  |  |
| Variant without industrial communication (2 cable glands <sup>3)</sup> M20x1.5 + 1 x 5 pin M12 male connector), operating voltage of 12...35 V DC |  |                                   |  |                   |                |                     |  |  |
| 08  | Ra<1.6                                     | Ra<0.8                            | 14 x 1.85; 25.0                        | 3                 | Yes            | Yes                 | 573126    |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 573128    |  |
| 15  |  | Ra<0.8                            | 21.3 x 1.6; 50.5                       | 10                |                | Yes                 | 566187    |  |
|   |  |                                   |  |                   |                | No                  | 566235    |  |
|   |  | Ra<0.4                            |  |                   |                | 21.3 x 1.6; 50.5    | Yes  | 566195  |
|   |  |                                   |  |                   |                | 21.3 x 1.6; 34.0    | No   | 566237  |
| 25  |  | Ra<0.8                            | 33.7 x 2.0; 50.5                       | 25                |                | Yes                 | 566188    |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 566196    |  |
| 40  |  | Ra<0.8                            | 48.3 x 2.0; 64.0                       | 56                |                |                     | 566189    |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 566197    |  |
| 50  |  | Ra<0.8                            | 60.3 x 2.0; 77.5                       | 90                |                |                     | 566190    |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 566198  |  |
| 65  |  | Ra<0.8                            | 76.1 x 2.0; 91.0                       | 147               |                |                     | 573442  |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 573370  |  |
| 80  |  | Ra<0.8                            | 88.9 x 2.3; 106.0                      | 200               |                |                     | 573443  |  |
|   |  | Ra<0.4                            |  |                   |                |                     | 573371  |  |

1.) D2 for holder; s = thickness; D3: clamp

2.) The EHEDG compliance is only valid if used in combination with gaskets from Combifit International B.V.

3.) Cable gland in nickel plated brass

Clamp process connection acc. to DIN 32676 series C for pipe acc. to DIN 11866 series C (ASME BPE)

**Note:**

- To set up a device without a display, please use the USB-büS interface, Type 8923 (has to be ordered separately - see chapter "9. Product accessories" on page 32 and "10.7. Ordering chart accessories" on page 42).
- All these variants are equipped with a display and the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size   | Surface quality                            |                                   | Dimensions <sup>1)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                     |     | Article no. |
|---|--|-----------------------------------|--|-------------------|----------------|---------------------|-----|-------------|
|   | Housing, outer surface of measurement tube | Inner surface of measurement tube |  |                   | 3A (28-06)     | EHEDG <sup>2)</sup> | UL  |             |
| [inch]  | [µm]                                       | [µm]                              | [mm]                                   | [m³/h]            |                |                     |     |             |
| Variant without industrial communication (2 cable glands <sup>3)</sup> M20x1.5+1x5 pin M12 male connector), operating voltage of 12...35 V DC |  |                                   |  |                   |                |                     |     |             |
| ⅜   | Ra<1.6                                     | Ra<0.8                            | 14.00x3.125; 25.0                      | 1.7               | Yes            | Yes                 | No  | 573112 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 573114 𐄂    |
| ½   |  | Ra<0.8                            | 14.00x2.3; 25.0                        | 2.5               |                |                     | No  | 573119 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 573123 𐄂    |
| ¾   |  | Ra<0.8                            | 19.05x1.65; 25.0                       | 7                 |                |                     | No  | 566203 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 569675 𐄂    |
| 1   |  | Ra<0.8                            | 25.4x1.65; 50.5                        | 14                |                |                     | No  | 566204 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 569676 𐄂    |
| 1½  |  | Ra<0.8                            | 38.1x1.65; 50.5                        | 35                |                |                     | No  | 566205 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 569677 𐄂    |
| 2   |  | Ra<0.8                            | 50.8x1.65; 64.0                        | 64                |                |                     | No  | 566206 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 569678 𐄂    |
| 2½  |  | Ra<0.8                            | 63.5x1.65; 77.5                        | 100               |                |                     | No  | 573448 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 574710 𐄂    |
| 3   |  | Ra<0.8                            | 76.2x1.65; 91.0                        | 150               |                |                     | No  | 573449 𐄂    |
|   |  | Ra<0.4                            |  |                   |                |                     | Yes | 574711 𐄂    |



| Clamp and pipe size  | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      |     | Article no. |
|--|--|-----------------------------------|---|-------------------|----------------|----------------------|-----|-------------|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   |                |                      |     |             |
| [inch]   | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            | 3A (28-06)     | EHEDG <sup>2.)</sup> | UL  |             |
| <b>Variant with industrial communication (Ethernet variant, 2 x 4 pin M12 female connectors + 1 x 5 pin M12 male connector), operating voltage of 12...35 V DC</b> |  |                                   |   |                   |                |                      |     |             |
| 3/8  | Ra < 1.6                                   | Ra < 0.4                          | 14.00 x 3.125; 25.0                     | 1.7               | Yes            | Yes                  | No  | 573117 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 573118 ๒    |
| 1/2  |  |                                   | 14.00 x 2.3; 25.0                       | 2.5               |                |                      | No  | 573124 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 573125 ๒    |
| 3/4  |  |                                   | 19.05 x 1.65; 25.0                      | 7                 |                |                      | No  | 570444 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 569679 ๒    |
| 1  |  |                                   | 25.4 x 1.65; 50.5                       | 14                |                |                      | No  | 570445 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 569680 ๒    |
| 1 1/2  |  |                                   | 38.1 x 1.65; 50.5                       | 35                |                |                      | No  | 570446 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 569681 ๒    |
| 2  |  |                                   | 50.8 x 1.65; 64.0                       | 64                |                |                      | No  | 570447 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 569682 ๒    |
| 2 1/2  |  |                                   | 63.5 x 1.65; 77.5                       | 100               |                |                      | No  | 574716 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 574720 ๒    |
| 3  |  |                                   | 76.2 x 1.65; 91.0                       | 150               |                |                      | No  | 574717 ๒    |
|  |  |                                   |   |                   |                |                      | Yes | 574721 ๒    |

1.) D2 for holder; s = thickness; D3: clamp

2.) The EHEDG compliance is only valid if used in combination with gaskets from Combifit International B.V.

3.) Cable gland in nickel plated brass

**Thread process connection acc. to DIN 11851 series A for pipe acc. to DIN 11866 series A (DIN 11850)****Note:**

- To set up a device without a display, please use the USB-büS interface, Type 8923 (has to be ordered separately - see chapter “9. Product accessories” on page 32 and “10.7. Ordering chart accessories” on page 42).
- All these variants are equipped with a display and the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Thread and pipe size   | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      | Article no. |
|--|--|-----------------------------------|---|-------------------|----------------|----------------------|-------------|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   |                |                      |             |
| [mm]   | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            | 3A (28-06)     | EHEDG <sup>1.)</sup> |             |
| <b>Variant without industrial communication (2 cable glands<sup>2.)</sup> M20x1.5 + 1 x 5 pin M12 male connector), operating voltage of 12...35 V DC</b> |  |                                   |   |                   |                |                      |             |
| 65   | Ra < 1.6                                   | Ra < 0.8                          | 70.0 x 2.0; Rd 95 x 1/6                 | 123               | Yes            | Yes                  | 573463 ๒    |
| 80   |  | Ra < 0.8                          | 85.0 x 2.0; Rd 110 x 1/4                | 185               |                |                      | 573464 ๒    |

1.) D2 for holder; s = thickness; D3: thread connection







2.) The EHEDG compliance is only valid if used in combination with EHEDG-compliant gaskets from

1. Kieselmann GmbH, Germany (ASEPTO-STAR k-flex upgrade gaskets) or

2. Siersema Komponenten Service (S.K.S.) B.V. (Netherlands SKS gasket set DIN 11851 EHEDG with EPDM or FKM inner gasket)

3.) Cable gland in nickel plated brass

## Further versions on request

|   |   |   |   |
|---|---|---|---|
|  | <b>Process connection</b> <ul style="list-style-type: none"> <li>For pipe DIN 11850: <ul style="list-style-type: none"> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe ISO 1127: <ul style="list-style-type: none"> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe ASME BPE: <ul style="list-style-type: none"> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe SMS 3008: SMS 3017</li> </ul> |  | <b>Additional</b> <ul style="list-style-type: none"> <li>With/without display</li> <li>Without differentiation factor (DF)</li> <li>Without acoustic transmission factor (ATF)</li> <li>With density and massflow</li> <li>With one concentration measurement</li> <li>With two concentration measurements</li> <li>Ethernet module (EtherNet/IP, PROFINET, Modbus TCP/IP, ETHERCAT)</li> <li>ATEX/IECEX</li> </ul> |
|  | <b>Orifice</b> <ul style="list-style-type: none"> <li>08...80 mm</li> <li>¾...3 inch</li> </ul>   |  | <b>Material</b> <ul style="list-style-type: none"> <li>With inner surface of measurement tube <ul style="list-style-type: none"> <li>Ra &lt; 0.8 µm (30 µin.)</li> <li>Ra &lt; 0.4 µm (15 µin.) (electro-polished) according to ISO 4288</li> </ul> </li> </ul>   |
|  |   |  | <b>Electrical connection</b><br>Cable gland in stainless steel  |





For any other variants, please use the product enquiry form at the end of this data sheet or check the readily available article no. listed in the Bürkert eShop.

## 10.6. Ordering chart FLOWave S flowmeter

Clamp process connection acc. to DIN 32676 series A for pipe acc. to DIN 11866 series A (DIN 11850)

## Note:

All these variants are equipped with the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size  | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      | Article no.  |
|--|--|-----------------------------------|---|-------------------|----------------|----------------------|--|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   | 3A (28-06)     | EHEDG <sup>2.)</sup> |  |
| [mm]   | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            |                |                      |  |
| Electrical connection: 1 x 8 pin M12 male connector, operating voltage of 12...35 V DC |  |                                   |   |                   |                |                      |  |
| 65   | Ra < 1.6                                   | Ra < 0.8                          | 70.0 x 2.0; 91.0                        | 123               | Yes            | Yes                  | 574689  |
|  |  | Ra < 0.4                          |   |                   |                |                      | 573421  |
| 80   |  | Ra < 0.8                          | 85.0 x 2.0; 106.0                       | 185               |                |                      | 574690  |
|  |  | Ra < 0.4                          |   |                   |                |                      | 573422  |

1.) D2 for holder; s = thickness; D3: clamp

2.) The EHEDG compliance is only valid if used in combination with gaskets from Combifit International B.V.

Clamp process connection acc. to DIN 32676 series B for pipe acc. to DIN 11866 series B (ISO 1127)

**Note:**

All these variants are equipped with the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size  | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      | Article no. |
|--|--|-----------------------------------|---|-------------------|----------------|----------------------|-------------|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   |                |                      |             |
| [mm]   | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            | 3A (28-06)     | EHEDG <sup>2.)</sup> |             |
| Electrical connection: 1 × 5 pin M12 male connector, operating voltage of 12...35 V DC |  |                                   |   |                   |                |                      |             |
| 08   | Ra < 1.6                                   | Ra < 0.8                          | 14 × 1.85; 25.0                         | 3                 | Yes            | Yes                  | 573716      |
|  |  | Ra < 0.4                          |   |                   |                | No                   | 573717      |
| 15   |  | Ra < 0.8                          | 21.3 × 1.6; 50.5                        | 10                |                | Yes                  | 573093      |
|  |  |                                   |   |                   |                | No                   | 573094      |
|  |  | Ra < 0.4                          | 21.3 × 1.6; 50.5                        |                   |                | Yes                  | 573098      |
|  |  |                                   |   |                   |                | No                   | 573099      |
| 25   |  | Ra < 0.8                          | 33.7 × 2.0; 50.5                        | 25                |                | Yes                  | 573095      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 40   |  | Ra < 0.8                          | 48.3 × 2.0; 64.0                        | 56                |                |                      | 573096      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 50   |  | Ra < 0.8                          | 60.3 × 2.0; 77.5                        | 90                |                |                      | 573097      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| Electrical connection: 1 × 8 pin M12 male connector, operating voltage of 12...35 V DC |  |                                   |   |                   |                |                      |             |
| 08   | Ra < 1.6                                   | Ra < 0.8                          | 14 × 1.85; 25.0                         | 3                 | Yes            | Yes                  | 571780      |
|  |  | Ra < 0.4                          |   |                   |                | No                   | 571781      |
| 15   |  | Ra < 0.8                          | 21.3 × 1.6; 50.5                        | 10                |                | Yes                  | 571782      |
|  |  |                                   |   |                   |                | No                   | 571783      |
|  |  | Ra < 0.4                          | 21.3 × 1.6; 50.5                        |                   |                | Yes                  | 571784      |
|  |  |                                   |   |                   |                | No                   | 571785      |
| 25   |  | Ra < 0.8                          | 33.7 × 2.0; 50.5                        | 25                |                | Yes                  | 571786      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 40   |  | Ra < 0.8                          | 48.3 × 2.0; 64.0                        | 56                |                |                      | 571788      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 50   |  | Ra < 0.8                          | 60.3 × 2.0; 77.5                        | 90                |                |                      | 571790      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 65   |  | Ra < 0.8                          | 76.1 × 2.0; 91.0                        | 147               |                |                      | 574686      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |
| 80   |  | Ra < 0.8                          | 88.9 × 2.3; 106.0                       | 200               |                |                      | 574687      |
|  |  |                                   |   |                   |                |                      | Ra < 0.4    |

1.) D2 for holder; s = thickness; D3: clamp

2.) The EHEDG compliance is only valid if used in combination with gaskets from Combifit International B.V.

Clamp process connection acc. to DIN 32676 series C for pipe acc. to DIN 11866 series C (ASME BPE)

**Note:**

All these variants are equipped with the special functions ATF (acoustic transmission factor) and DF (differentiation factor).

| Clamp and pipe size  | Surface quality                            |                                   | Dimensions <sup>1)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                     |     | Article no. |
|--|--|-----------------------------------|--|-------------------|----------------|---------------------|-----|-------------|
|  | Housing, outer surface of measurement tube | Inner surface of measurement tube |  |                   | 3A (28-06)     | EHEDG <sup>2)</sup> | UL  |             |
| [inch]   | [µm]                                       | [µm]                              | [mm]                                   | [m³/h]            | 3A (28-06)     | EHEDG <sup>2)</sup> | UL  |             |
| Electrical connection: 1 × 5 pin M12 male connector, operating voltage of 12...35 V DC |  |                                   |  |                   |                |                     |     |             |
| 3/8  | Ra<1.6                                     | Ra<0.8                            | 14.00×3.125; 25.0                      | 1.7               | Yes            | Yes                 | No  | 573710      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573711      |
| 1/2  |  | Ra<0.8                            | 14.00×2.3; 25.0                        | 2.5               |                |                     | No  | 573712      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573713      |
| 3/4  |  | Ra<0.8                            | 19.05×1.65; 25.0                       | 7                 |                |                     | No  | 573714      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573715      |
| 1  |  | Ra<0.8                            | 25.4×1.65; 50.5                        | 14                |                |                     | No  | 573085      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573086      |
| 1 1/2  |  | Ra<0.8                            | 38.1×1.65; 50.5                        | 35                |                |                     | No  | 573087      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573088      |
| 2  |  | Ra<0.8                            | 50.8×1.65; 64.0                        | 64                |                |                     | No  | 573089      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 573090      |
| Electrical connection: 1 × 8 pin M12 male connector, operating voltage of 12...35 V DC |  |                                   |  |                   |                |                     |     |             |
| 3/8  | Ra<1.6                                     | Ra<0.8                            | 14.00×3.125; 25.0                      | 1.7               | Yes            | Yes                 | No  | 571792      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571793      |
| 1/2  |  | Ra<0.8                            | 14.00×2.3; 25.0                        | 2.5               |                |                     | No  | 571794      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571795      |
| 3/4  |  | Ra<0.8                            | 19.05×1.65; 25.0                       | 7                 |                |                     | No  | 571796      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571797      |
| 1  |  | Ra<0.8                            | 25.4×1.65; 50.5                        | 14                |                |                     | No  | 571798      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571799      |
| 1 1/2  |  | Ra<0.8                            | 38.1×1.65; 50.5                        | 35                |                |                     | No  | 571800      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571801      |
| 2  |  | Ra<0.8                            | 50.8×1.65; 64.0                        | 64                |                |                     | No  | 571802      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571803      |
| 2 1/2  |  | Ra<0.8                            | 63.5×1.65; 77.5                        | 100               |                |                     | No  | 571804      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571805      |
| 3  |  | Ra<0.8                            | 76.2×1.65; 91.0                        | 150               |                |                     | No  | 571806      |
|  |  | Ra<0.4                            |  |                   |                |                     | Yes | 571807      |

1.) D2 for holder; s = thickness; D3: clamp

2.) The EHEDG compliance is only valid if used in combination with gaskets from Combifit International B.V.

Visit product website ►

40 | 43



บริษัท ฟลูเทค จำกัด  
FLU-TECH CO.,LTD

845/3-4 หมู่ 3 ถ.เทพารักษ์ ต.เทพารักษ์ อ.เมือง จ.สมุทรปราการ 10270  
845/3-4 Thepharak RD., T.Thepharak, A.Muang, Samutprakarn 10270 THAILAND  
Tel. 0 2384 6060, Fax 0 2384 5701, Email : sales@flutech.co.th, www.flutech.co.th



Thread process connection acc. to DIN 11851 series A for pipe acc. to DIN 11866 series A (DIN 11850)

**Note:**

All these variants are equipped with the special functions ATF (acoustic transmission factor) and DF (density factor).






| Thread and pipe size  | Surface quality                            |                                   | Dimensions <sup>1.)</sup><br>D2 x s; D3 | Maximal flow rate | Certifications |                      | Article no. |
|---|--|-----------------------------------|---|-------------------|----------------|----------------------|-------------|
|   | Housing, outer surface of measurement tube | Inner surface of measurement tube |   |                   |                |                      |             |
| [mm]  | [µm]                                       | [µm]                              | [mm]                                    | [m³/h]            | 3A (28-06)     | EHEDG <sup>2.)</sup> |             |
| <b>Electrical connection: 1 x 8 pin M12 male connector, operating voltage of 12...35 V DC</b> |  |                                   |   |                   |                |                      |             |
| 65  | Ra < 1.6                                   | Ra < 0.8                          | 70.0 x 2.0; Rd 95 x 1/6                 | 123               | Yes            | Yes                  | 574707 ฆ    |
| 80  |  | Ra < 0.8                          | 85.0 x 2.0; Rd 110 x 1/4                | 185               |                |                      | 574708 ฆ    |

1.) D2 for holder; s = thickness; D3: thread connection

2.) The EHEDG compliance is s only valid if used in combination with EHEDG-compliant gaskets from

1. Kieselmann GmbH, Germany (ASEPTO-STAR k-flex upgrade gaskets) or

2. Siersema Componenten Service (S.K.S.) B.V. (Netherlands SKS gasket set DIN 11851 EHEDG with EPDM or FKM inner gasket)

| Further versions on request  |   |
|--|---|
|  <b>Process connection</b> <ul style="list-style-type: none"> <li>For pipe DIN 11850: <ul style="list-style-type: none"> <li>Clamp DIN 32676</li> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe ISO 1127: <ul style="list-style-type: none"> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe ASME BPE: <ul style="list-style-type: none"> <li>Clamp DIN 11864-3</li> <li>Flange DIN 11864-2</li> </ul> </li> <li>For pipe SMS 3008: SMS 3017</li> </ul> |  <b>Orifice</b> <ul style="list-style-type: none"> <li>08...80 mm</li> <li>3/8...3 inch</li> </ul>   |
|  |  <b>Additional</b> <ul style="list-style-type: none"> <li>Without differentiation factor (DF)</li> <li>Without acoustic transmission factor (ATF)</li> <li>With density and massflow</li> <li>With one concentration measurement</li> <li>With two concentration measurements</li> <li>ATEX/IECEX</li> </ul> |
|  |  <b>Material</b> <ul style="list-style-type: none"> <li>With inner surface of measurement tube <ul style="list-style-type: none"> <li>Ra &lt; 0.8 µm (30 µin.)</li> <li>Ra &lt; 0.4 µm (15 µin.) (electro-polished) according to ISO 4288</li> </ul> </li> </ul>   |
|  |  <b>Electrical connection</b> <ul style="list-style-type: none"> <li>1 x 5 pin M12 male connector</li> <li>1 x 8 pin M12 male connector</li> </ul>   |

For any other variants, please use the product enquiry form at the end of this data sheet or check the readily available article no. listed in the Bürkert eShop.

## 10.7. Ordering chart accessories

| Description  |   | Article no.  |
|--|---|--------------|
| Display module, Type ME31  |   | 265468       |
| Blind cover in stainless steel 304/1.4301  |   | 265467       |
|  | Unlocking magnetic key  | 690309       |
| System Connect   |   |              |
| Type ME43 Gateway / Interface  |   |              |
| bÜS/Ethernet (PROFINET, EtherNet/IP, Modbus TCP, EtherCAT)                                 |   | 307390       |
| bÜS/Profibus DP  |   | 307393       |
| Type ME61 Display  |   |              |
| Process View Display 3.5" (8.9 cm)   |   | 368544       |
| EDIP Accessories   |   |              |
| bÜS Stick Set  |   |              |
|  | USB-bÜS-Interface Set 1, Type 8923. Detailed information can be found in chapter “9. Product accessories” on page 32. | 772426       |
| USB-bÜS Interface Set 2, Type 8923 (only bÜS Stick, cable and bÜS service cable)           |   | 772551       |
| Connectors   |   |              |
| 5 pin M12 female straight bÜS cable plug   |   | 772416       |
| 5 pin M12 male straight bÜS cable plug   |   | 772417       |
| 5 pin M12 female angled bÜS cable plug   |   | 772418       |
| 5 pin M12 male angled bÜS cable plug   |   | 772419       |
| bÜS Y-connector, 5 pin M12 female to 5 pin M12 male and 5 pin M12 female                   |   | 772420       |
| bÜS Y-connector, 5 pin M12 female to 5 pin M12 male and 5 pin M12 female (power interrupt) |   | 772421       |
| bÜS adaptor M12 male A-coded - M12 male A-coded  |   | 772867       |
| bÜS termination, 5 pin M12 male cable plug   |   | 772424       |
| bÜS termination, 5 pin M12 female cable plug   |   | 772425       |
| Adaptor cable, 8 pin M12 female - 5 pin M12 male   |   | 773286       |
| Connectors with cable  |   |              |
| 5 pin M12 female angled cable plug moulded on bÜS cable, with open leads                   |   | 0,7 m 772626 |
| 5 pin M12 female straight cable plug moulded on bÜS cable, with open leads                 |   | 1 m 772409   |
|  |   | 3 m 772410   |
|  |   | 5 m 772411   |
|  |   | 10 m 772412  |
| Micro USB and 5 pin M12 male straight cable plug moulded on bÜS cable                      |   | 0,3 m 773254 |
| 8 pin M12 female straight cable plug moulded on bÜS cable, with open leads                 |   | 2 m 919061   |
| Extensions   |   |              |
|  | 5 pin M12 female and male straight cable plug moulded on bÜS cable, shielded  | 0,1 m 772492 |
|  |   | 0,2 m 772402 |
|  |   | 0,5 m 772403 |
|  |   | 1 m 772404   |
|  |   | 3 m 772405   |
|  |   | 5 m 772406   |
|  |   | 10 m 772407  |
|  |   | 20 m 772408  |
| Type 1573 Power Supplies   |   |              |
| 1 A (NEC Class 2 Power Units)  |   | 772361       |
| 2 A (NEC Class 2 Power Units)  |   | 772362       |
| 3.8 A (NEC Class 2 Power Units)  |   | 772898       |
| 10 A   |   | 772698       |